

CASE 1 NEW CONNECTION TO EXISTING SEWER MAIN

R.O.W. LINE OR BACK OF SIDEWALK

FINISHED GRADE

3M ELECTRONIC BALL MARKER PLACED DIRECTLY ABOVE CONNECTION POINT

CONNECTION TO MAIN USING INSERTA-TEE OR APPROVED GASKETED SADDLE CORE-DRILLED 45 DEGREES TO VERTICAL AS APPROVED BY CITY ENGINEER

"WYE" TO BE APPROVED BY CITY ENGINEER

6" MIN. ASTM-D-3034 SDR-35, SDR-26, OR SCHEDULE 40 PVC PIPE

12"

NON-METALLIC PLUG OR CAP SEALED IN SAME MANNER AS SEWER LATERAL JOINTS

6" MIN. ASTM-D-3034 SDR-35, SDR-26, OR SCHEDULE 40 PVC PIPE, LENGTH VARIES. SLOPE TO DRAIN, 2.00% MIN.

EXISTING SEWER MAIN

CROWN / TOP OF MAIN ELEVATION PROJECTED TO PROPERTY LINE PIPE

GASKETED WYE FITTING ROTATED UPWARD TO FACILITATE GRAVITY FLOW INTO THE SEWER MAIN LINE

6" MIN. ASTM-D-3034 SDR-35, SDR-26, OR SCHEDULE 40 PVC PIPE, LENGTH VARIES, SLOPE TO DRAIN.

SEWER LATERAL INVERT ELEVATION AT PROPERTY LINE TO BE AT OR ABOVE CROWN ELEVATION OF SEWER MAIN

CAP SEALED IN SAME MANNER AS SEWER LATERAL JOINTS

1. ALL CONNECTIONS MUST BE APPROVED BY THE CITY OF WENATCHEE AND INSTALLED PER MANUFACTURERS RECOMMENDATIONS.
2. LATERAL CONNECTIONS TO THE MAIN LINE SHALL BE A MINIMUM OF 2 FEET APART.
3. LATERAL CONNECTIONS TO THE PUBLIC MAIN LINE SHALL BE DESIGNED TO FLOW BY GRAVITY THROUGH THE POINT OF CONNECTION. PRESSURE SYSTEMS SHALL DISCHARGE INTO GRAVITY FLOW NO LESS THAN 10 FEET UPSTREAM OF THE POINT OF CONNECTION BETWEEN THE 6 INCH LATERAL AND THE MAIN LINE.
4. THE SANITARY SEWER LATERAL, INCLUDING THE TAP, SADDLE, TEE, PIPE, AND CLEANOUT IS CONSIDERED "PRIVATE" UPSTREAM OF THE MAIN LINE POINT OF CONNECTION.
5. MINIMUM 6 INCH DIAMETER CLEANOUTS SHALL BE CONSTRUCTED ON ALL SEWER LATERALS. THE VERTICAL RISER SHALL BE OF EQUAL SIZE AS THE LATERAL PIPE OR LARGER.
6. CLEANOUTS MAY BE LOCATED IN THE PLANTER STRIP AT THE BACK OF WALK, IF ONE EXISTS, AND SHALL BE VISIBLE AT FINISHED GRADE. CLEANOUTS LOCATED BELOW FINISHED GRADE SHALL HAVE ACCESSIBLE COVER.
7. 3M ELECTRONIC BALL MARKER TO BE PLACED 24 TO 36 INCHES BELOW FINISHED GRADE AND SHALL BE GREEN IN PIGMENT.
8. CASE 1: CONNECTIONS TO EXISTING SEWER MAINS SHALL BE CUT USING A HOLE SAW. CONNECTIONS TO EXISTING MAIN LINES SHALL UTILIZE AN APPROVED TAPPING SADDLE OR TEE-WYE CONNECTION. LATERALS SHALL NOT PROTRUDE INTO THE MAIN LINE.
9. CASE 2: CONNECTIONS TO NEWLY CONSTRUCTED MAIN LINES SHALL UTILIZE A MANUFACTURED, GASKETED TEE-WYE INSTALLED IN-LINE WITH THE NEW SEWER MAIN. CORE-DRILLING OF NEW SEWER MAIN LINES FOR SEWER LATERALS SHALL NOT BE PERMITTED.
10. CASE 3: WHERE INSUFFICIENT GRADE EXISTS TO ALLOW SEWERS TO BE INSTALLED IN ACCORDANCE WITH CASE 1 OR 2, FLATTER SEWERS ARE PERMISSIBLE ON A CASE-BY-CASE BASIS AS DETERMINED BY THE CITY ENGINEER. CONNECTIONS SHALL UTILIZE A MANUFACTURED, GASKETED TEE-WYE FITTING INSERTED INTO THE MAIN LINE. CUTTING OR DRILLING BELOW SPRINGLINE IS PROHIBITED. THE INVERT ELEVATION OF THE PRIVATE SEWER LATERAL AT THE PROPERTY LINE IN SUCH INSTANCES SHALL BE AT OR ABOVE THE ELEVATION OF THE CROWN OF THE PUBLIC SEWER MAIN. PRIOR TO SUCH APPROVAL, A SITE-SPECIFIC CONSTRUCTION PLAN AND DETAIL MUST BE PROVIDED TO AND APPROVED BY THE CITY ENGINEER. ANY COSTS ASSOCIATED WITH BYPASS PUMPING WILL BE AT THE CONTRACTOR'S EXPENSE.

STANDARD DETAIL SANITARY SIDE SEWER 12 INCH AND SMALLER MAINS




SCALE: AS SHOWN		DATE DRAWN		REVISIONS	
N.A.		3/23/2015		INITIAL	
DESIGNED	DRAWN	CHECKED	DATE		
DMN	RDH	DMN	6/19/2015	DMN	
APPROVED BY		DATE APPROVED	2/9/2016	NH	
		3/23/2015	01/01/2022	AJS	
STANDARD SPECIFICATIONS					
WSDOT 7-08 PIPE INSTALL					
WSDOT 7-18 SIDE SEWERS					
SPECIAL PROVISION 7-18.3(f)					

DETAIL NO.

S-100

PAGE
1 OF 1

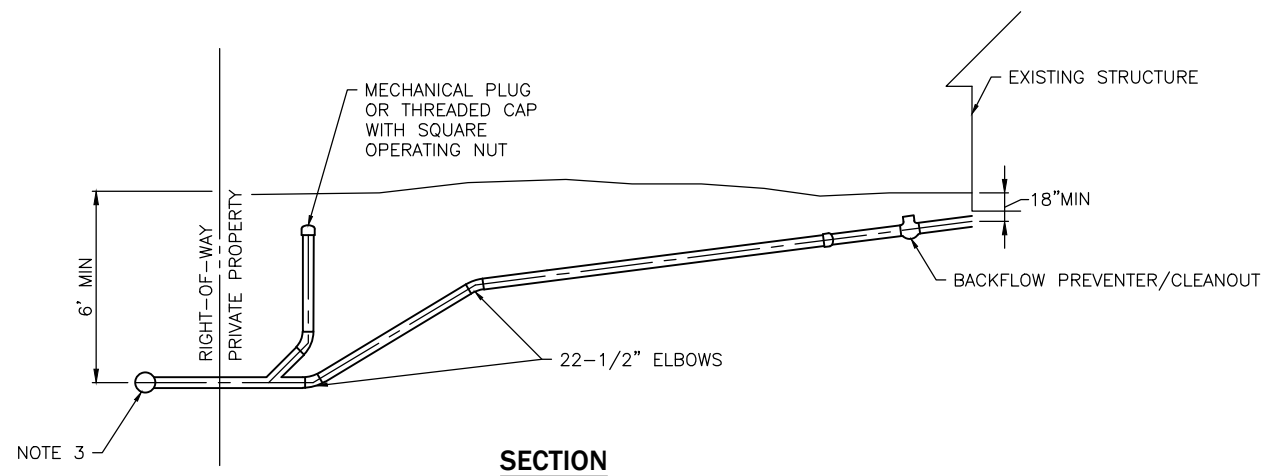


1. ELBOWS SHALL NOT BE GREATER THAN 45 DEGREES.
2. CLEAN OUT IS REQUIRED FOR EACH PIPE LENGTH GREATER THAN 100' AND FOR EACH 90 DEGREES ACCUMULATED ELBOW PER 100'
3. RIGHT-OF-WAY RESTORATION SHALL MATCH OR EXCEED THE ORIGINAL CONDITION AND BE IN ACCORDANCE WITH THE CITY STANDARD.
4. FOR PIPE PLACED UNDER PAVED AREAS, THE ABOVE BACKFILL ABOVE PIPE ZONE BEDDING SHALL BE PLACED IN HORIZONTAL LAYERS NO MORE THAN 6-INCHES THICK AND COMPACTED TO 95% MAXIMUM DRY DENSITY.
5. ALL HOUSE PLUMBING OUTLETS MUST BE CONNECTED TO THE SEWER. NO DOWNSPOUTS OR STORM DRAINAGE MAY BE CONNECTED TO THE SEWER SYSTEM.
6. 6' MINIMUM COVERAGE AT PROPERTY LINE.
7. LAY PIPE IN STRAIGHT LINE BETWEEN BENDS. MAKE ALL CHANGES IN GRADE OR LINE WITH A 1/8 BEND OR WYE. 90 DEGREE CHANGE WITH 1/8 BEND AND WYE.
8. 6" SEWER PIPE MINIMUM SIZE IN STREET, AND ELSEWHERE AS DIRECTED BY ENGINEER. 2% MINIMUM GRADE (UNLESS DIRECTED BY ENGINEER) 50% MAXIMUM.
9. 4" SEWER PIPE MINIMUM SIZE ON PROPERTY. 2% MINIMUM GRADE, 100% (45 DEGREE) MAXIMUM.
10. CONSTRUCTION IN STREET MUST BE DONE BY A LICENSED CONTRACTOR.
11. ALL CONSTRUCTION REQUIRES A PERMIT AND PAYMENT OF FEE, COMPLETE LEGAL DESCRIPTION OF PROPERTY AND DIMENSIONS.
12. BACKFLOW PREVENTER (CHECK VALVE) IS REQUIRED:
 - A. IF CONNECTED TO A COMBINED SIDE SEWER.
 - B. IF CONNECTION AT HOUSE IS LOWER THAN UPSTREAM MANHOLE LID.
13. AS-BUILT DRAWING SHOWING LOCATION OF SIDE SEWER IN RELATION TO THE HOUSE IS REQUIRED AFTER INSTALLATION.
14. CLANOUTS SHALL BE VISIBLE AT FINISH GRADE. IF INSTALLED BELOW FINISH GRADE, AN ACCESSIBLE COVER IS REQUIRED.


STANDARD DETAIL RESIDENTIAL SIDE SEWER INSTALLATION



SCALE: AS SHOWN		DATE DRAWN 12/04/2020	REVISONS	
DESIGNED	DRAWN	CHECKED	DATE	INITIAL
APPROVED BY			01/01/2022	AJS
STANDARD SPECIFICATIONS		DATE APPROVED		
DETAIL NO. S-110				
PAGE 1 OF 1				

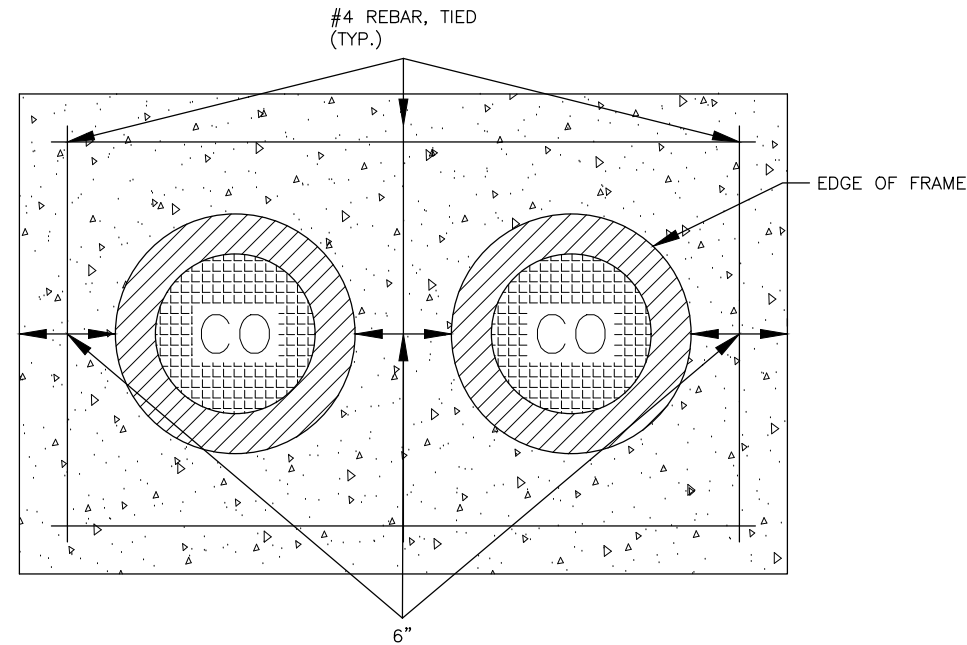


1 CLEANOUT PLAN VIEW
Scale: N.T.S.

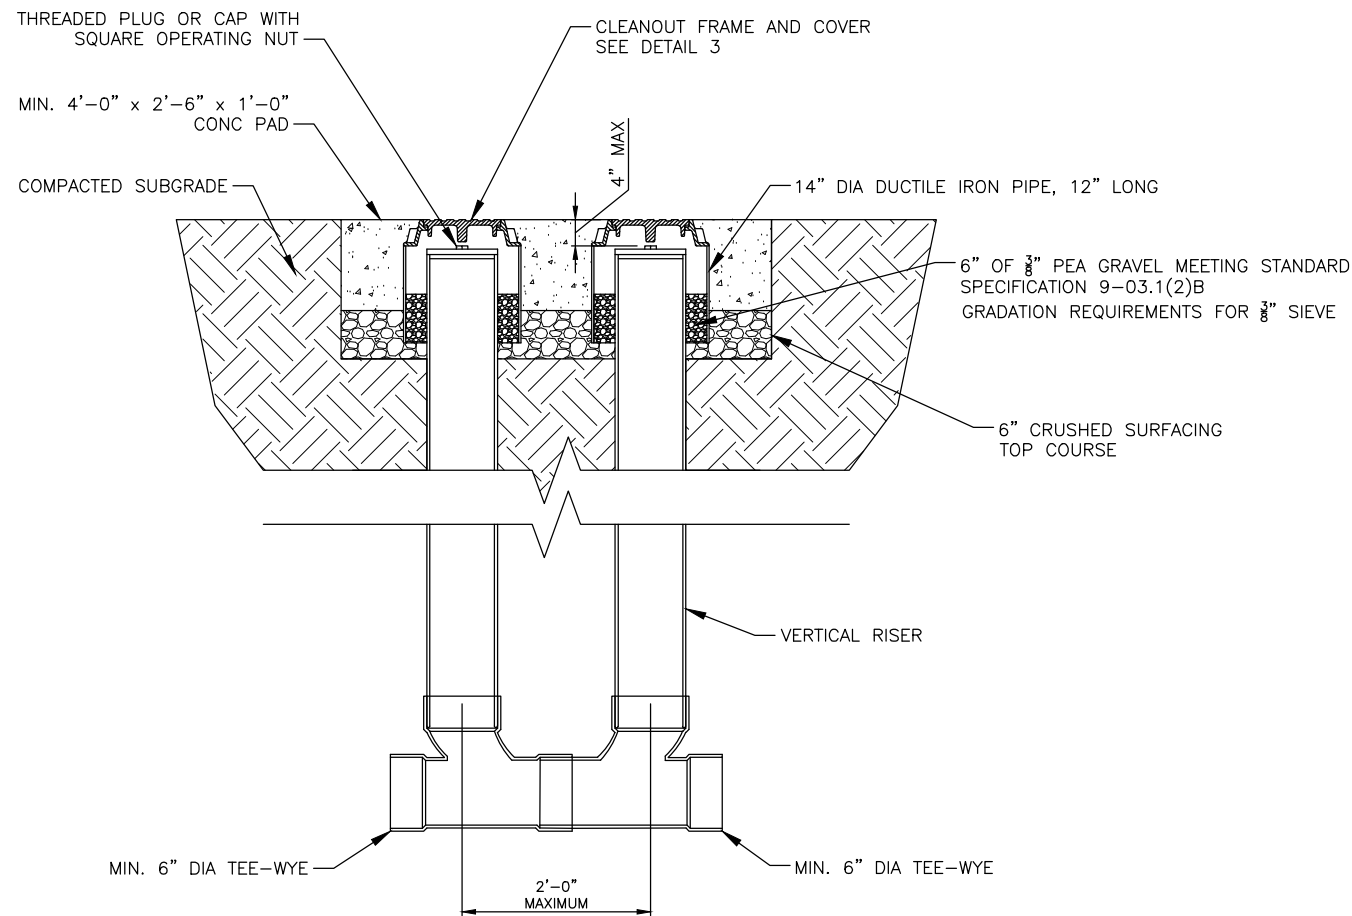

2 CLEANOUT DETAIL
Scale: N.T.S.

NOTES:

1. ALL CONNECTIONS MUST BE APPROVED BY THE CITY OF WENATCHEE AND INSTALLED PER MANUFACTURER RECOMMENDATIONS.
2. THE SANITARY SEWER LATERAL, INCLUDING THE TAP, SADDLE, TEE, PIPE, AND CLEANOUT IS CONSIDERED "PRIVATE" UPSTREAM OF THE MAIN LINE POINT OF CONNECTION.
3. MINIMUM 6" DIAMETER CLEANOUTS SHALL BE CONSTRUCTED ON ALL SEWER LATERALS. THE VERTICAL RISER SHALL BE OF EQUAL SIZE AS THE LATERAL PIPE OR LARGER.
4. CLEANOUTS MAY BE LOCATED IN THE PLANTER STRIP AT THE BACK OF WALK, IF ONE EXISTS, AND SHALL BE VISIBLE AT FINISHED GRADE. CLEANOUTS LOCATED BELOW FINISHED GRADE SHALL HAVE ACCESSIBLE COVERS.
5. CLEANOUT FRAME AND COVER SHALL BE HEAVY DUTY, BOLT DOWN EAST JORDAN MODEL 3675 OR APPROVED EQUAL AND LABELED "SEWER" OR "CLEANOUT".
6. MAXIMUM CENTER-TO-CENTER SPACING BETWEEN CLEANOUTS SHALL BE 2'-0". MODIFICATIONS TO THIS SPACING REQUIRE THE APPROVAL OF THE ENGINEER.
7. CONCRETE PAD FC' SHALL BE 3,000 PSI OR GREATER.
8. ALL #4 REBAR SHALL HAVE 2" MINIMUM COVER.

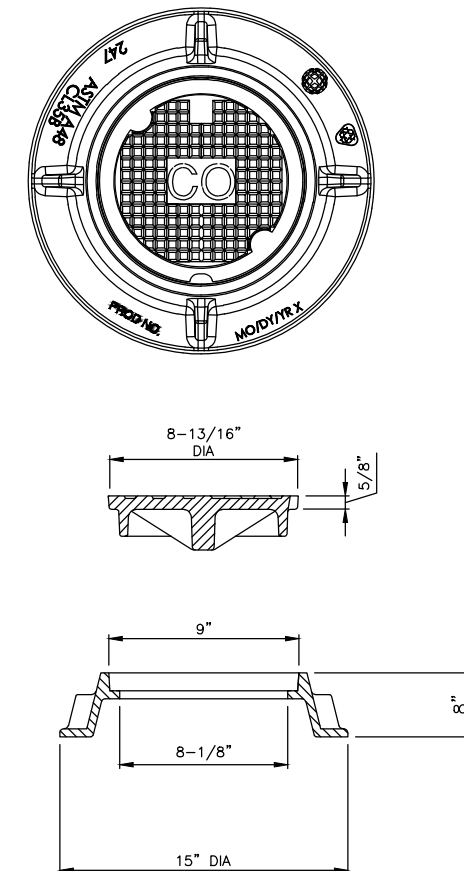

3 CLEANOUT FRAME AND COVER
Scale: N.T.S.

STANDARD DETAIL
SANITARY SEWER
DOUBLE CLEANOUT



SCALE: AS SHOWN	DATE DRAWN	DESIGNED	DRAWN	APPROVED BY	DATE	INITIAL	DATE	INITIAL	DATE	INITIAL	DATE	INITIAL	DATE	INITIAL	DATE	INITIAL	DATE	INITIAL	DATE
3/9/2020	SRD	SRD	SRD	SRD	3/9/2020														
STANDARD SPECIFICATIONS WSDOT 7-08 GENERAL PIPE INSTALLATION WSDOT 7-18 SIDE SEWERS WSDOT 7-19 SEWER CLEANOUTS																			

DETAIL NO.
S-120



PAGE
1 OF 1



**SECTION A-A - DUCTILE IRON
NON LOCKING COVER
MINIMUM WEIGHT 100 LBS.**

MINIMUM WEIGHT 100 LBS.


- NOTES:**
- STANDARD SPECIFICATION SECTION 9-05.15(1) AND 9-06.14
1. COVER SHALL BE AT MINIMUM 100LBS
 2. MINIMUM WEIGHT OF FRAME SHALL BE 134 LBS
 3. PRODUCT SUPPLIES BY EAST JOURDAN IRON WORKS, OR APPROVED EQUAL
 4. CITY OF WENATCHEE LOGO REQUIRED
 5. FRAME AND COVER SHALL BE H-20 LOADING RATED

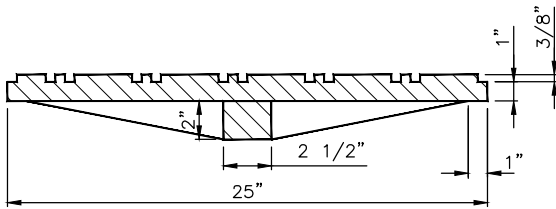

STACKING DETAIL



3715Z STACKING
GRAY OR DUCTILE IRON FRAME

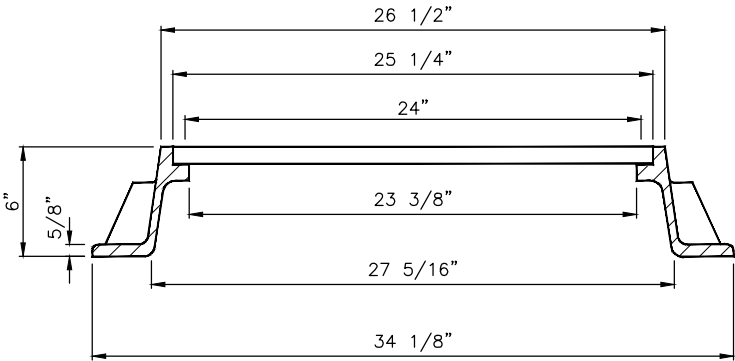

SECTION B-B
GRAY IRON OR DUCTILE IRON FRAME
MINIMUM WEIGHT 135 LBS.

STANDARD DETAIL

CIRCLE FRAME RING

AND COVER DETAIL



SCALE: AS SHOWN		DATE DRAWN 02/21/06	REVISIONS	
DESIGNED	DRAWN	CHECKED	DATE	INITIAL
	RLK	SK	10/03/18	DWN
APPROVED BY			09/17/20	CAW
		DATE APPROVED	01/01/2022	AJS
		STANDARD SPECIFICATIONS		


DETAIL NO.

S-150

PAGE

1 OF 1

MAXIMUM SEWER PIPE 10"Ø

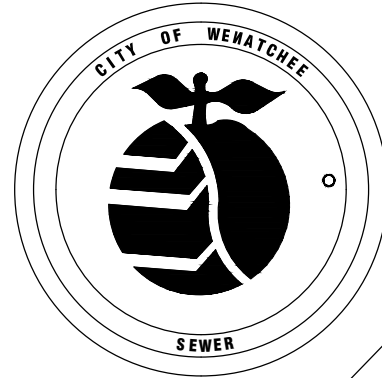

FRAME & COVER

SEWER

8" REMOVABLE PLUG

4" ADJUSTING RING

6" RISER RING

2'

48" DIA. CAST IN PLACE CONCRETE SLAB. 6 INCH MINIMUM AROUND RISERS

6" COMPACTED SUBGRADE @ 95% DENSITY

6" MIN. C.S.B.C. @ 95% DENSITY

45° BEND

8" DIA

8" DIA

PLUG SHALL BE SEALED IN SAME MANNER AS MAIN SEWER JOINTS

PLUG SHALL BE SEALED IN SAME MANNER AS MAIN SEWER JOINTS

SURVEY ELEVATION AND LOCATION END OF PIPE FOR AS-BUILT

NOTES:

1. CONSTRUCTION PER WSDOT STANDARDS
2. PAVEMENT REPAIR TO BE MADE TO MATCH EXISTING TRENCH BACKFILL OR AS AUTHORIZED
3. PERMIT REQUIRED ON ALL PROJECTS ADMINISTERED BY CITY ENGINEER


NOTES:

1. CONSTRUCTION PER WSDOT STANDARD SPECIFICATIONS.
2. PAVEMENT REPAIR TO BE MADE WITHIN 24 HOURS OF TRENCH BACKFILL OR AS AUTHORIZED BY CITY ENGINEER.
3. PERMIT REQUIRED ON ALL PROJECTS, NOT CONTRACT ADMINISTERED BY CITY ENGINEERING DEPARTMENT.

**STANDARD DETAIL
SANITARY SEWER MAIN
CLEANOUT**



SCALE: AS SHOWN		DATE DRAWN		REVISIONS	
N.A.		3/23/2015		INITIAL	
DESIGNED	DRAWN	CHECKED	DATE		
DMN	ROH	DMN	01/01/2022	AJS	
APPROVED BY		DATE APPROVED			
		3/23/2015			
STANDARD SPECIFICATIONS					
7-05 MANHOLES					
7-17 SANITARY SEWER					
DETAIL NO.					
S-160					
PAGE					
1 OF 1					

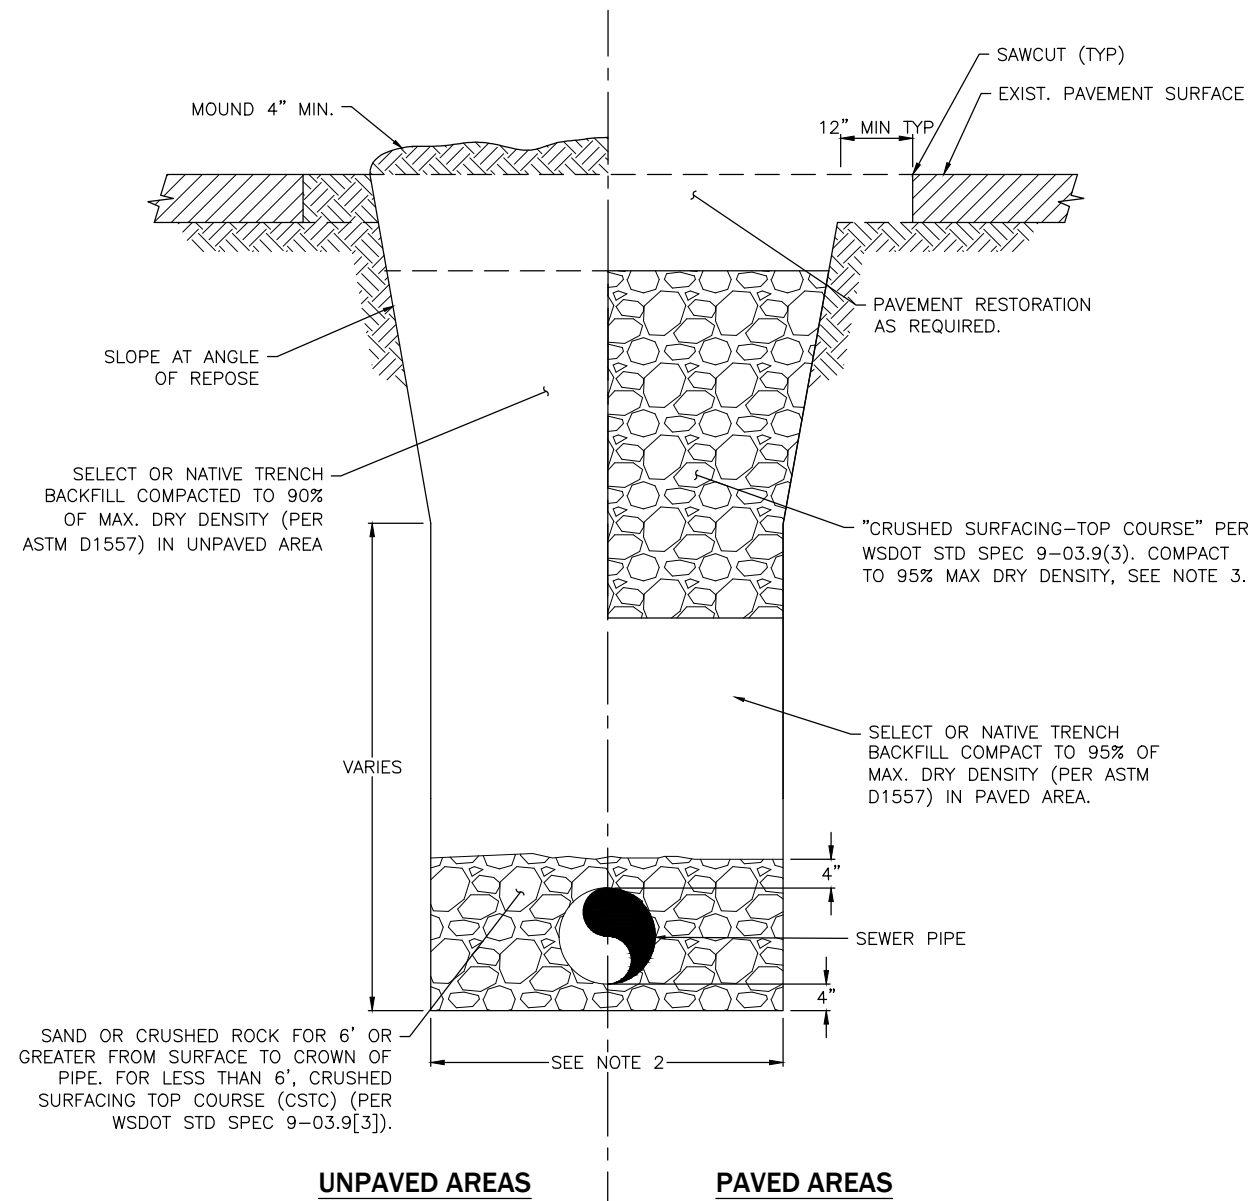

NOTES:

1. TRENCH BACKFILL BELOW TOP 4 FEET MAY BE NATIVE MATERIALS OR AS REQUIRED BY THE SPECIFICATIONS, OR AS DIRECTED BY THE PUBLIC WORKS INSPECTOR.
2. MINIMUM TRENCH WIDTH SHALL BE PIPE ID +24". MAX WIDTH NOT TO EXCEED 6'.
3. IN PAVED AREAS USE CRUSHED ROCK BACKFILL.
 - * FULL DEPTH OF TRENCH WHERE SEWER MAIN CROSSES PERPENDICULAR TO THE TRAVELED LANE OR DRIVEWAY.
 - * TOP FOUR FEET WHERE SEWER MAIN RUNS PARALLEL TO THE TRAVELED LANE, UNLESS EXISTING MATERIAL IS DETERMINED BY THE ENGINEER TO BE SUITABLE FOR BACKFILL.
4. SEE CITY OF WENATCHEE POLICY R-2, AND STANDARD DETAIL R-310 FOR OVERLAY REQUIREMENTS.

STANDARD DETAIL SANITARY SEWER TRENCH



SCALE: AS SHOWN	DATE DRAWN		REVISIONS	
	DESIGNED	DRAWN	DATE	INITIAL
			CHECKED	AJS
APPROVED BY	DATE APPROVED			
STANDARD SPECIFICATIONS				

DETAIL NO.

S-200

PAGE

1 OF 1



AWWA STANDARD			
TYPE OF PIPE	PIPE	JOINT	FITTINGS
DUCTILE IRON	C 1.52	C 111	C 110
CONCRETE CYLINDER	C 303		

1. HORIZONTAL SEPARATION (PARALLEL) – A MINIMUM HORIZONTAL SEPARATION OF TEN (10) FEET BETWEEN GRAVITY SANITARY SEWERS AND ANY POTABLE WATER LINES SHALL BE MAINTAINED, WHENEVER POSSIBLE. THE DISTANCE SHALL BE MEASURED FROM EDGE TO EDGE.
2. UNUSUAL CONDITIONS (PARALLEL) – WHEN LOCAL CONDITIONS PREVENT A HORIZONTAL SEPARATION AS DESCRIBED ABOVE, A GRAVITY SEWER LINE MAY BE LAID CLOSER THAN TEN (10) FEET TO A WATER LINE PROVIDED:
 - A) IT IS LAID IN A SEPARATE TRENCH; OR IT IS LAID IN THE SAME TRENCH WITH THE WATER LINE THAT IS LOCATED AT ONE SIDE ON A BENCH OF UNDISTURBED EARTH; AND
 - B) IN EITHER CASE, THE ELEVATION OF THE CROWN OF THE GRAVITY SEWER MUST BE AT LEAST 18 INCHES BELOW THE INVERT OF THE WATER LINE. WHEN THIS VERTICAL SEPARATION CANNOT BE OBTAINED, THE GRAVITY SEWER SHALL BE CONSTRUCTED OF MATERIALS AND JOINTS THAT ARE 8 EQUIVALENT TO WATER MAIN STANDARDS OF CONSTRUCTION AND SHALL BE PRESSURE TESTED TO ASSURE WATER TIGHTNESS PRIOR TO BACKFILLING.
3. VERTICAL SEPARATION (PERPENDICULAR) – SEWER LINES CROSSING WATER LINES SHALL BE LAID BELOW THE WATER LINES TO PROVIDE A SEPARATION OF AT LEAST 18 INCHES BETWEEN THE INVERT OF THE WATER LINE AND THE CROWN OF THE SEWER LINE, WHENEVER POSSIBLE.
4. UNUSUAL CONDITIONS (PERPENDICULAR) – WHEN LOCAL CONDITIONS PREVENT A VERTICAL SEPARATION AS DESCRIBED ABOVE, THE FOLLOWING CONSTRUCTION SHALL BE USED:
 - A) GRAVITY SEWERS PASSING OVER OR UNDER WATER LINES SHALL BE:
 - I. CONSTRUCTED OF MATERIAL DESCRIBED ON THIS PAGE. THE ONE SEGMENT OF THE MAXIMUM STANDARD LENGTH OF PIPE (BUT NO LESS THAN 18 FEET LONG) SHALL BE USED WITH THE PIPES CENTERED TO MAXIMIZE JOINT SEPARATION; OR
 - II. CONSTRUCTED OF STANDARD GRAVITY SEWER MATERIAL ENCASED IN CONCRETE OR IN A 1/4" THICK CONTINUOUS STEEL CASING WITH ALL VOIDS PRESSURE-GROUTED WITH SAND-CEMENT GROUT.
 - III. THE LENGTH OF THE SEWER PIPE, IN BOTH I. AND II. ABOVE, SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE WATER LINE. THE SEWER PIPE SHALL BE THE LONGEST STANDARD LENGTH AVAILABLE FROM THE MANUFACTURER.
 - B) WATER LINES PASSING UNDER GRAVITY SEWERS, IN ADDITION, SHALL BE PROTECTED BY PROVIDING:
 - I. A VERTICAL SEPARATION OF AT LEAST 18 INCHES BETWEEN THE INVERT OF THE SEWER AND THE CROWN OF THE WATER LINE;
 - II. ADEQUATE STRUCTURAL SUPPORT FOR THE SEWERS TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING ON AND BREAKING OF THE WATER LINES; AND
 - III. THE LENGTH OF THE SEWER PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE WATER LINE. THE SEWER PIPE SHALL BE THE LONGEST STANDARD LENGTH AVAILABLE FROM THE MANUFACTURER.
 - C) PRESSURE SEWERS SHALL ONLY BE CONSTRUCTED UNDER WATER LINES WITH DUCTILE IRON PIPE OR STANDARD SEWER PIPE IN A STEEL CASING FOR A DISTANCE OF AT LEAST TEN (10) FEET ON EACH SIDE OF THE CROSSING.


STANDARD DETAIL WATER AND SEWER SPACING & CLEARANCE



SCALE: AS SHOWN		DATE DRAWN	REVISIONS	
DESIGNED	DRAWN	12/04/2020	DATE	INITIAL
CAW		CHECKED	01/01/2022	AJS
APPROVED BY		DATE APPROVED		
STANDARD SPECIFICATIONS				


DETAIL NO.
S-210

PAGE
1 OF 1

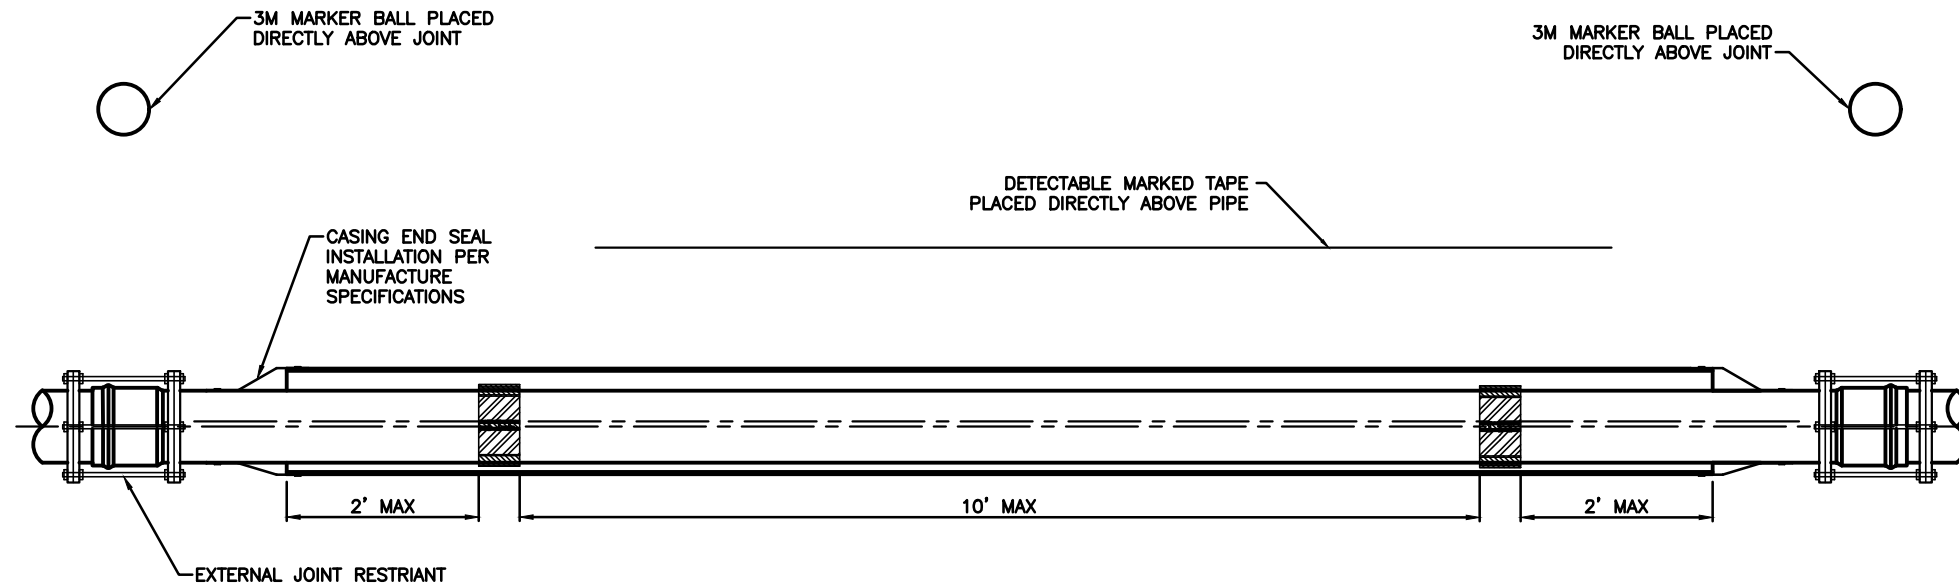


NOTES:


1. CARRIER PIPE SHALL BE USED AS REQUIRED WITHIN CITY RIGHT-OF-WAY.
2. ALL IRRIGATION PIPE LOCATED WITHIN CITY RIGHT-OF-WAY SHALL BE PVC C900 OR APPROVED EQUAL
3. ALL JOINTS THROUGHOUT CASING SHALL BE RESTRAINED WITH FIELD LOC INTERNAL RESTRAINTS OR APPROVED EQUAL.
4. RESTRAIN CARRIER PIPE ONE JOINT BEYOND END SEALS.
5. MANUFACTURED CASING SPACER INTERVAL PER MANUFACTURER'S SPECIFICATIONS BUT NOT MORE THAN 10- FEET. MINIMUM 3 SPACERS PER PIPE LENGTH.
6. CASING SHALL BE WELDED STEEL OR DUCTILE IRON FOR INSTALLATIONS LESS THAN 3- FEET BELOW ROAD GRADE. CPE MAY BE SUBSTITUTED FOR AREAS OUTSIDE OF PAVED ROADWAY.
7. CASING PIPE LENGTHS SHALL BE OF THE LONGEST AVAILABLE LENGTH OF PIPE FROM MANUFACTURER
8. NON- WELDED STEEL CASING SHALL BE EXTERNALLY RESTRAINED AT ALL JOINTS.
9. 3M MARKER BALL TO BE PLACED DIRECTLY ABOVE JOINT RESTRAINT AT END OF PIPE.
10. DETECTABLE MARKER TAPE TO BE INSTALLED 12- INCHES TO 14- INCHES ABOVE PIPE CASING. COLOR SHOULD BE ACCORDING TO APWA UNIFORM COLOR CODE FOR MARKING UNDERGROUND UTILITIES. DETECTABLE MARKING TAPE SHALL CONSIST OF INERT POLYETHYLENE PLASTIC THAT IS IMPERVIOUS TO ALL KNOWN ALKALIS, ACIDS, CHEMICAL REAGENTS, AND SOLVENTS LIKELY TO BE ENCOUNTERED IN THE SOIL, WITH A METALLIC FOIL CORE TO PROVIDE FOR THE MOST POSITIVE DETECTION AND PIPELINE LOCATION. DETECTABLE MARKING TAPE SHALL BE NO LESS THAN 2- INCHES WIDE, TYPE OF BURIED UTILITY SHOULD BE CLEARLY MARKED CONTINUOUSLY ALONG THE LENGTH OF THE RIBBON WITH MINIMUM 1-1/2 INCH LETTERS IN THE FOLLOWING FORMAT: "CAUTION BURIED (UTILITY TYPE) LINE"

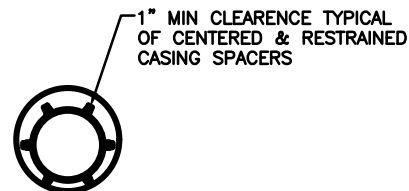

CASING SPACERS DETAIL
N.T.S.

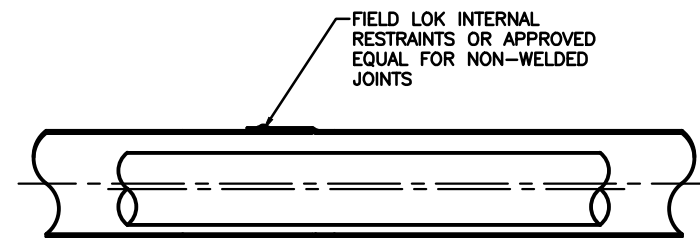


NON WELDED JOINT DETAIL
N.T.S.

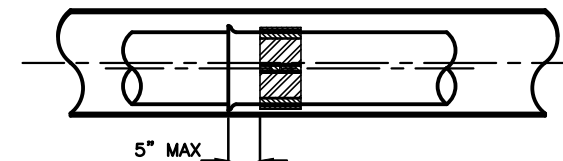



SPACER DISTANCE FROM BELL DETAIL
N.T.S.

STANDARD DETAIL
CARRIER PIPE

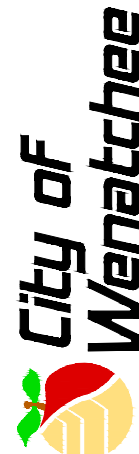

SCALE: AS SHOWN	DATE DRAWN	DATE	REVISIONS				DATE APPROVED	STANDARD SPECIFICATIONS
			INITIAL	DATE	BY	CAW		
DESIGNED	2/21/2006	12/20/2017	JBY	10/27/2020	CAW	AJS		
DRAWN								
APPROVED BY								

DETAIL NO.
S-250

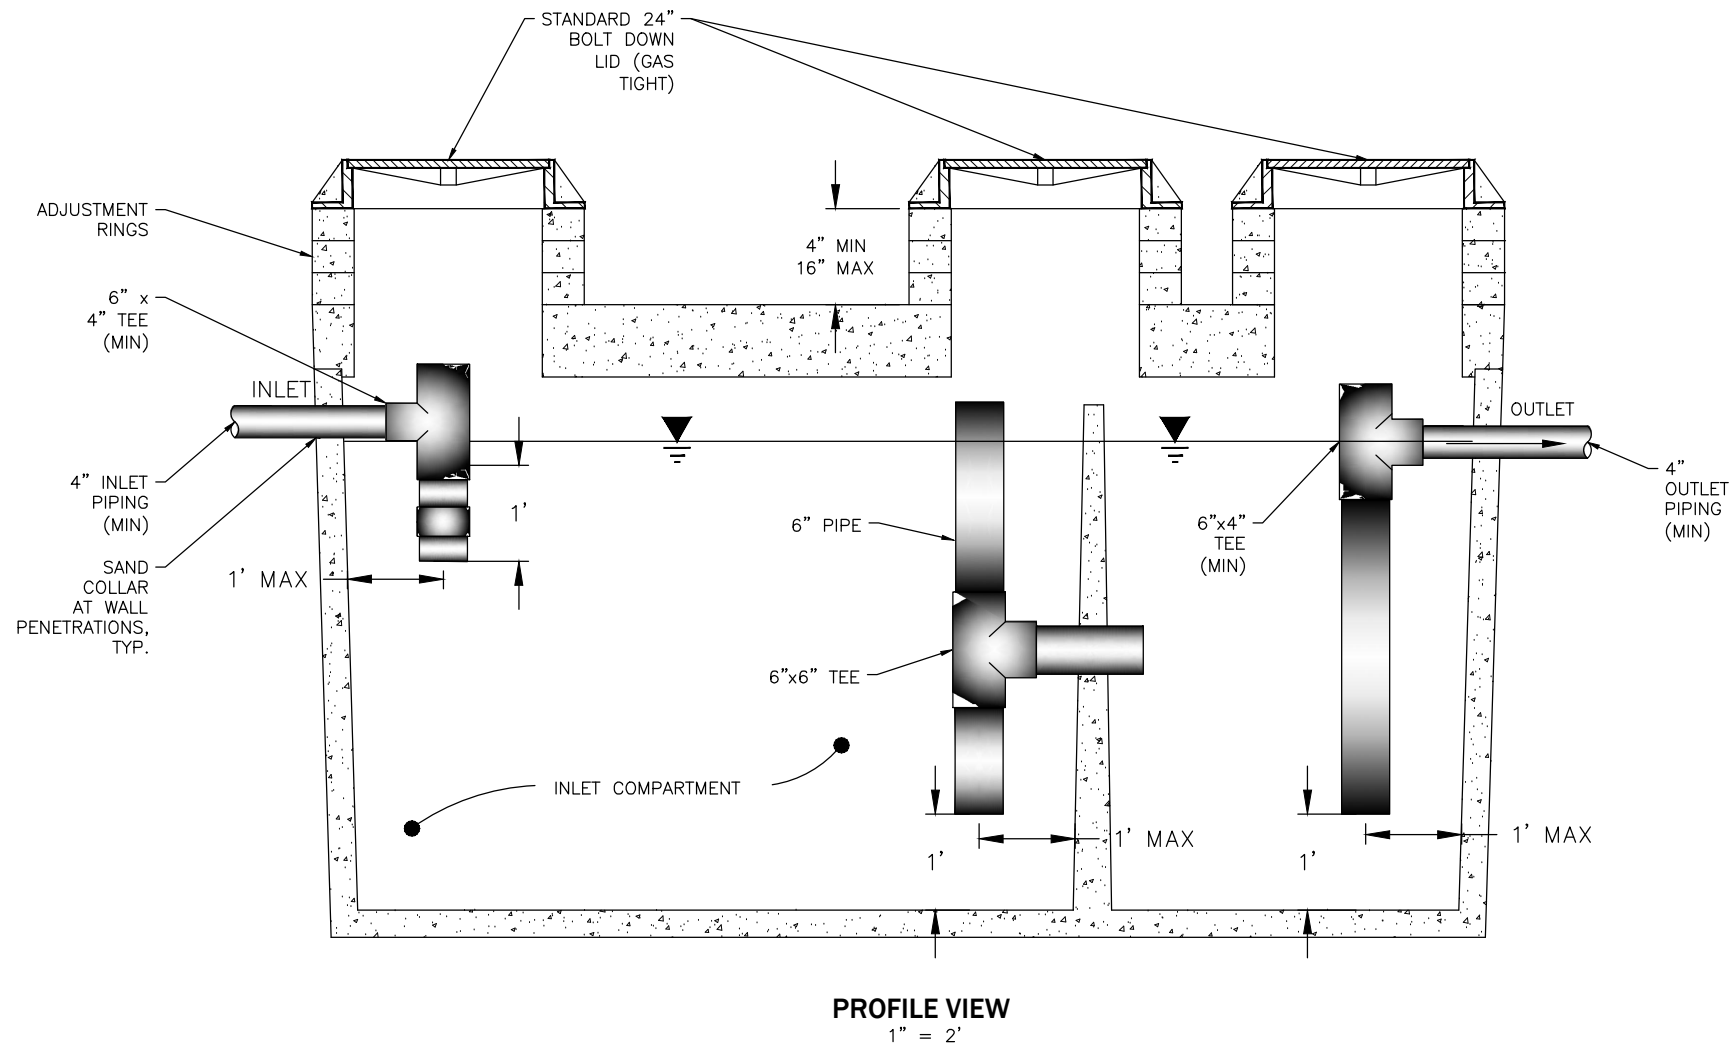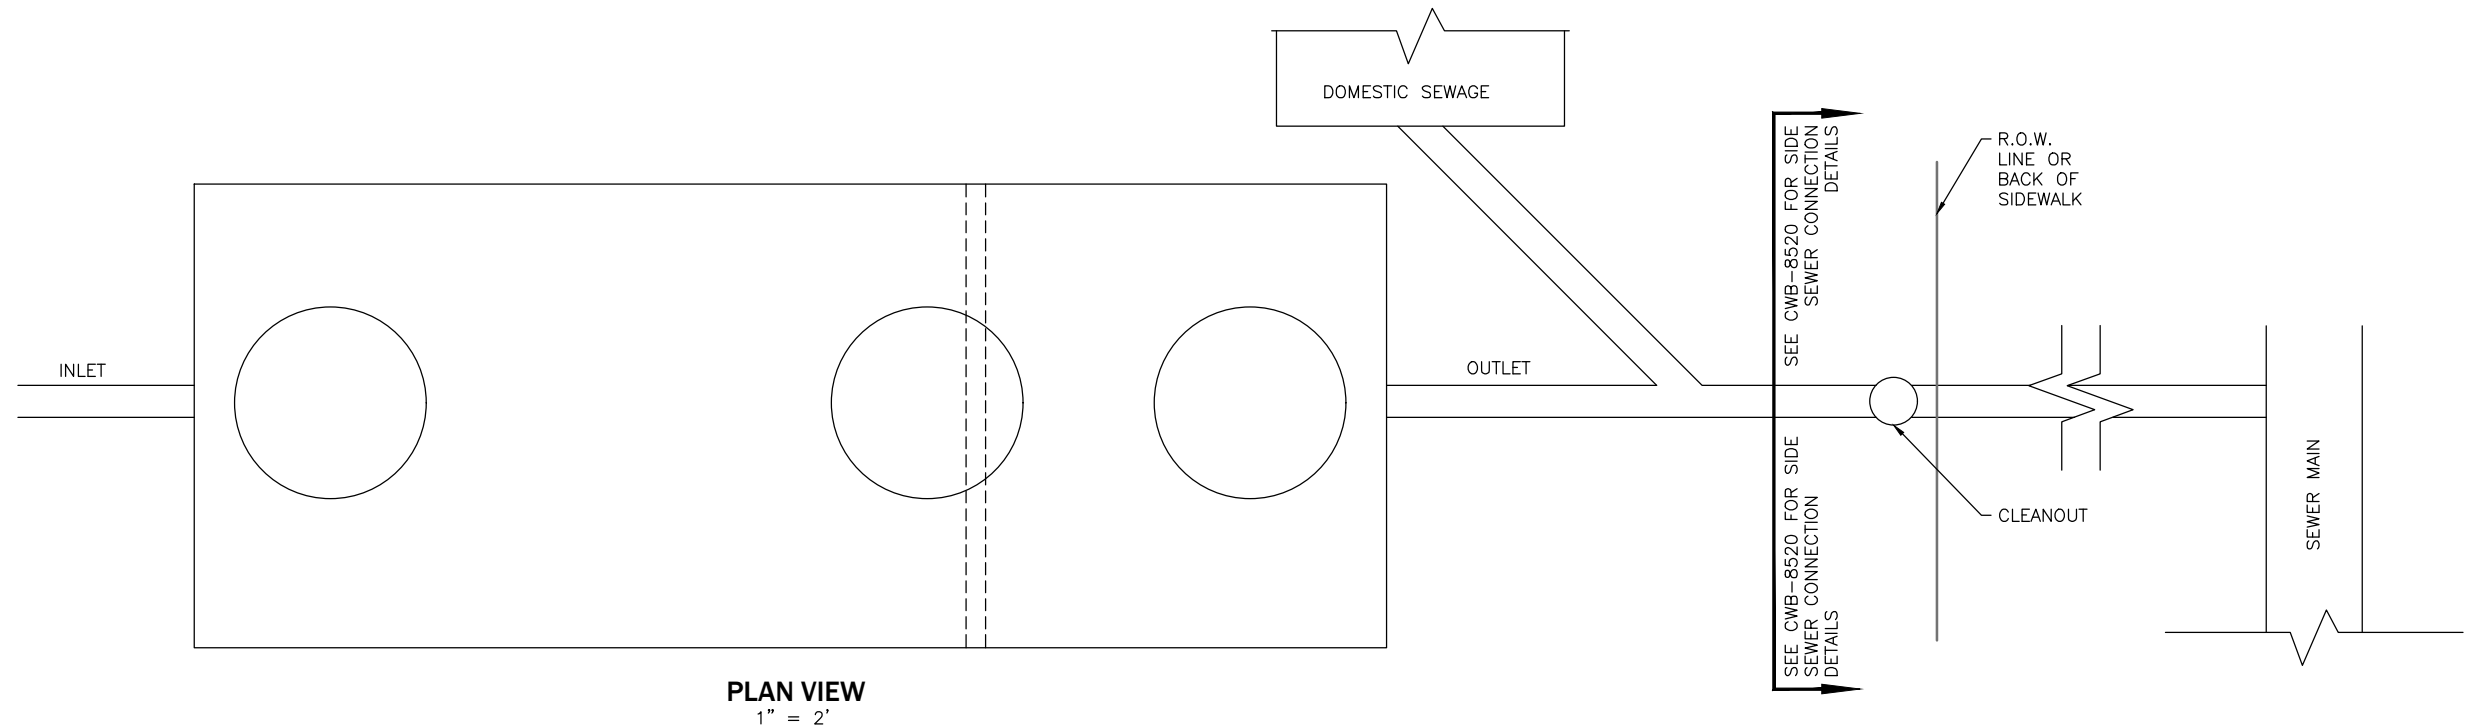

NOTES:

1. ALL INTERCEPTORS SHALL BE SIZED ACCORDING TO THE MOST RECENT VERSION OF THE UNIFORM PLUMBING CODE, 1014.3, OR OTHER ACCEPTABLE SIZING METHOD.
2. COMMERCIAL FOOD WASTE DISPOSALS AND DISHWASHERS MUST BE CONNECTED TO THE INTERCEPTOR, THE SIZING SHALL ACCOUNT FOR THESE FIXTURES.
3. INTERCEPTOR SHALL BE A MINIMUM SIZE OF 500 GALLONS OF LIQUID CAPACITY. THE INLET COMPARTMENT SHALL HAVE 2/3 THE TOTAL CAPACITY OF THE INTERCEPTOR.
4. SANITARY SEWER SHALL BE CONVEYED BY A SEPARATE LINE DOWNSTREAM OF THE INTERCEPTOR. ONLY GREY-WATER SHALL BE ROUTED THROUGH THE INTERCEPTOR.
5. PLACE INTERCEPTOR IN LOCATION THAT ALLOWS FOR PUMP TRUCK MAINTENANCE ACCESS.
6. INTERCEPTOR UNIT SHALL BE RATED FOR H20-44 AASHTO LOADING. (CERTIFIED)
7. A CENTER MANHOLE IS REQUIRED AND SHALL HAVE STANDARD 24" BOLT DOWN LID.
8. POSITION ADJUSTMENT RINGS TO ALLOW ACCESS AND ENTRY.
9. INTERCEPTOR SHALL BE INSTALLED PER MANUFACTURERS RECOMMENDATIONS.
10. CENTER MANHOLE MUST BE CENTERED OVER THE CROSSOVER TEE AND BAFFLE, THE CROSSOVER TEE CAN BE OFFSET FROM CENTER.
11. GROUT INLET, OUTLET AND CROSSOVER TEES.
12. ALTERNATE STYLES OR BRANDS MAY BE ALLOWED WITH DIRECTOR'S WRITTEN APPROVAL.

**STANDARD DETAIL
GRAVITY GREASE
INTERCEPTOR**




SCALE: AS SHOWN	DESIGNED	DRAWN	APPROVED BY	DATE	REVISIONS			
					DATE	INITIAL	CAW	AJS
					12/21/2020			
					01/01/2021			

DETAIL NO.

S-300


PAGE

1 OF 1

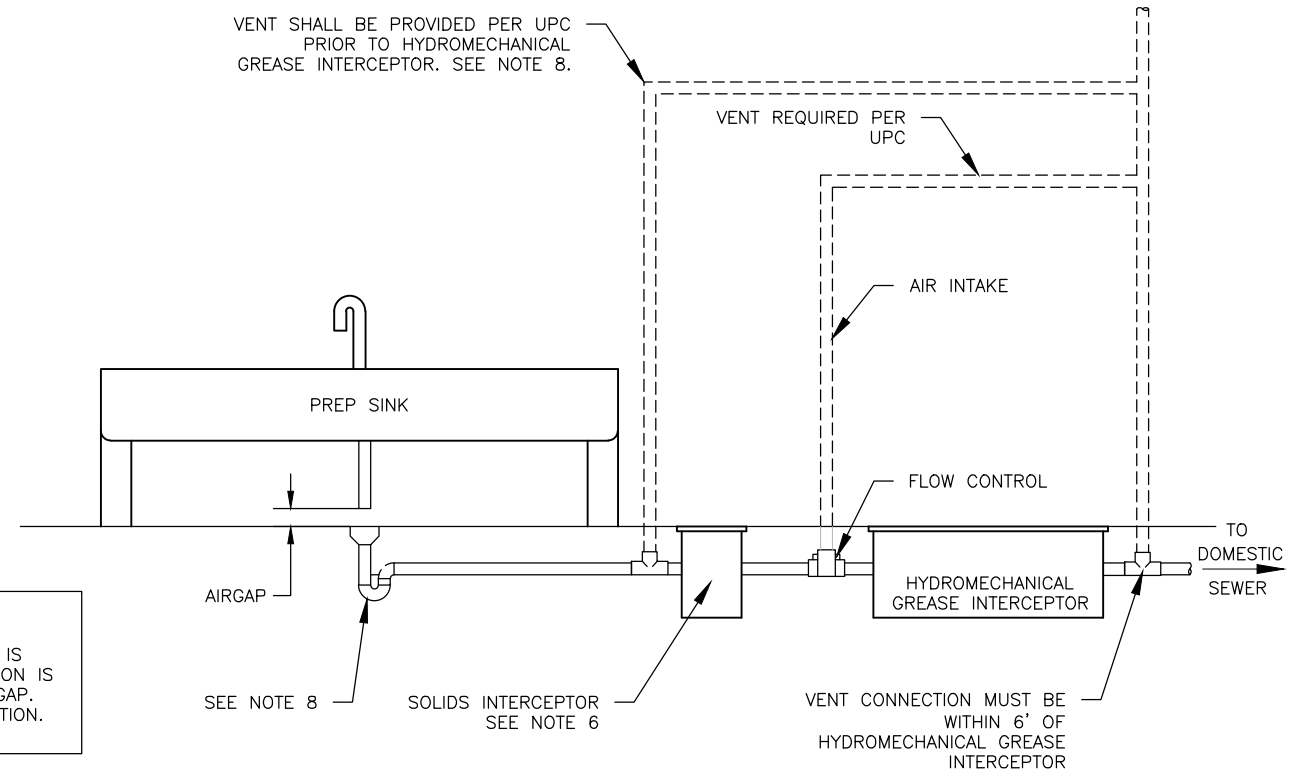

INDIRECT CONNECTIONS AS SHOWN:
IF ANY FOOD HANDLING OR BEVERAGE ICE SERVICE IS PROVIDED AT THE FIXTURES, AN INDIRECT CONNECTION IS REQUIRED. INDIRECT CONNECTIONS REQUIRE AN AIRGAP. SEE UPC CHAPTER 8 FOR MORE DETAILED INFORMATION.

INDIRECT CONNECTION

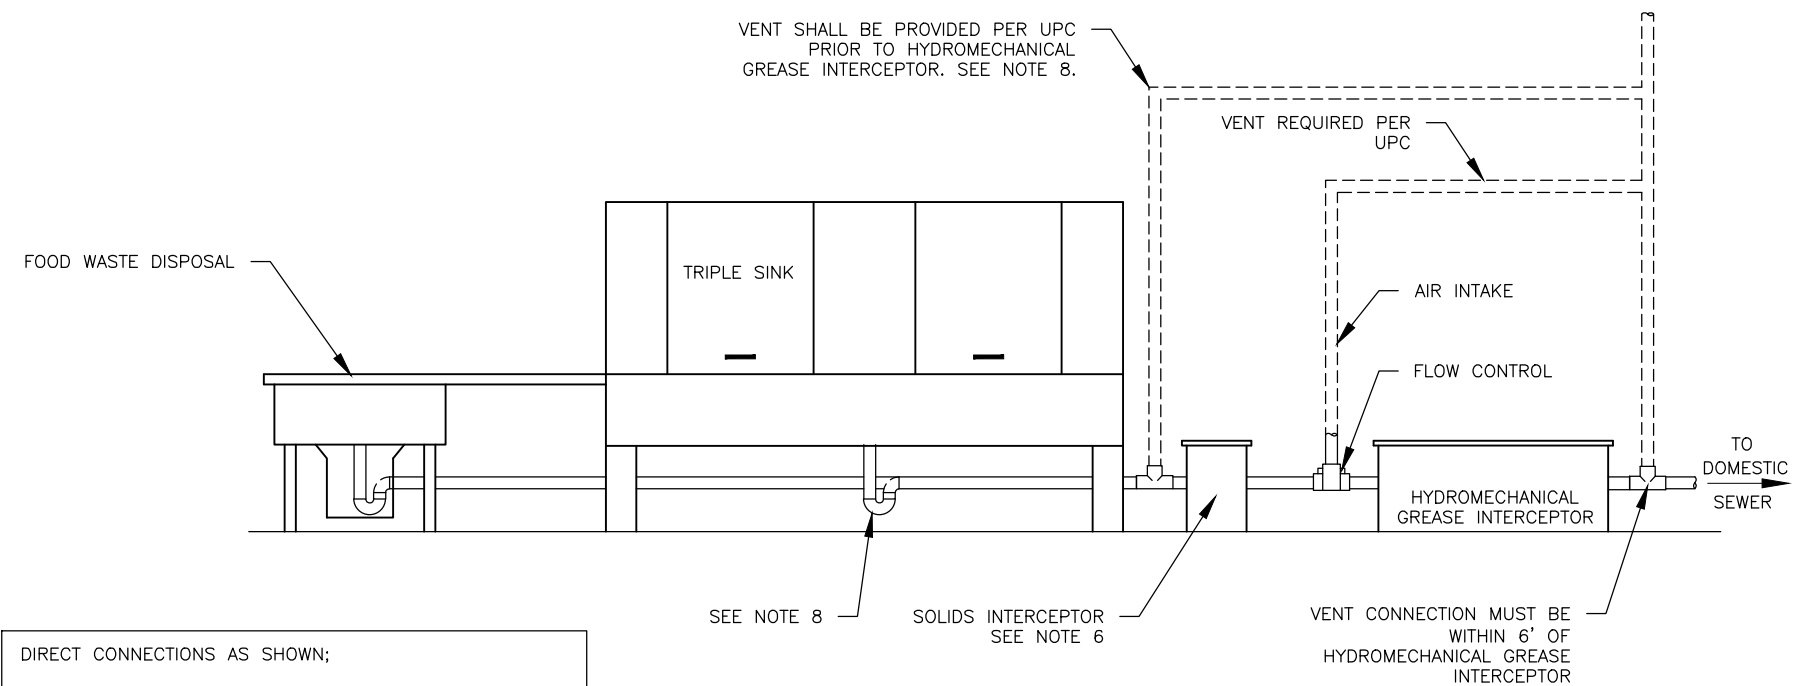

DIRECT CONNECTIONS AS SHOWN;
SHALL ONLY OCCUR IF NO FOOD HANDLING IS PERFORMED IN THESE AREAS. SEE UPC 801.

DIRECT CONNECTION

NOTES:

1. HYDROMECHANICAL GREASE INTERCEPTORS INSTALLED IN LIEU OF EXTERNAL GRAVITY GREASE INTERCEPTORS ARE ONLY ALLOWED WITH THE WRITTEN PERMISSION OF THE PUBLIC WORKS DIRECTOR.
2. MINIMUM REQUIRED FLOW RATE OF 20 GALLONS PER MINUTE AND GREASE RETENTION CAPACITY OF 40 POUNDS.
3. ALL INTERCEPTORS WILL BE APPROPRIATELY SIZED TO THE UNIFORM PLUMBING CODE OR OTHER ACCEPTABLE SIZING METHOD.
4. INSTALL THE INTERCEPTOR IN AN ACCESSIBLE LOCATION FOR EASE OF BOTH MAINTENANCE AND INSPECTIONS. THE TOP CLEARANCE SHALL PROVIDE TWO TIMES THE PHYSICAL DEPTH.
5. FOOD WASTE DISPOSALS MUST BE CONNECTED TO THE INTERCEPTOR.
6. IF A FOOD WASTE DISPOSAL IS CONNECTED, THEN THE INTERCEPTOR MUST HAVE A SOLIDS INTERCEPTOR INSTALLED PRIOR TO THE FLOW CONTROL DEVICE.
7. IF A SOLIDS INTERCEPTOR IS NOT REQUIRED, THEN A WATER SEAL MUST BE PROVIDED BETWEEN THE FIXTURES AND INTERCEPTOR.
8. EACH PLUMBING FIXTURE CONNECTED TO THE INTERCEPTOR SHALL BE INDIVIDUALLY TRAPPED AND VENTED IN AN APPROVED MANNER. VENTING AND FLOW CONTROL DEVICES ARE TO BE LOCATED IN A READILY ACCESSIBLE AND VISIBLE PLACE.
9. ALL WASTE SHALL ENTER THE INTERCEPTOR THROUGH AN INLET PIPE ONLY.
10. "GRAY WATER ONLY", DOMESTIC (SANITARY) SEWER SHALL BE CONVEYED BY A SEPARATE LINE DOWNSTREAM OF THE INTERCEPTOR.
11. DISHWASHER WASTE MUST NOT PASS THROUGH THE INTERCEPTOR.
12. NOT MORE THAN FOUR (4) SEPARATE FIXTURES SHALL BE CONNECTED TO OR DISCHARGE INTO ANY ONE INTERCEPTOR.







**STANDARD DETAIL
HYDROMECHANICAL
GREASE INTERCEPTOR**




SCALE: AS SHOWN	DESIGNED	DRAWN	APPROVED BY	STANDARD SPECIFICATIONS	REVISIONS			
					DATE	INITIAL	DATE	INITIAL
					12/21/2020	CAW	01/01/2022	AJS

DETAIL NO.
S-310

PAGE
1 OF 1

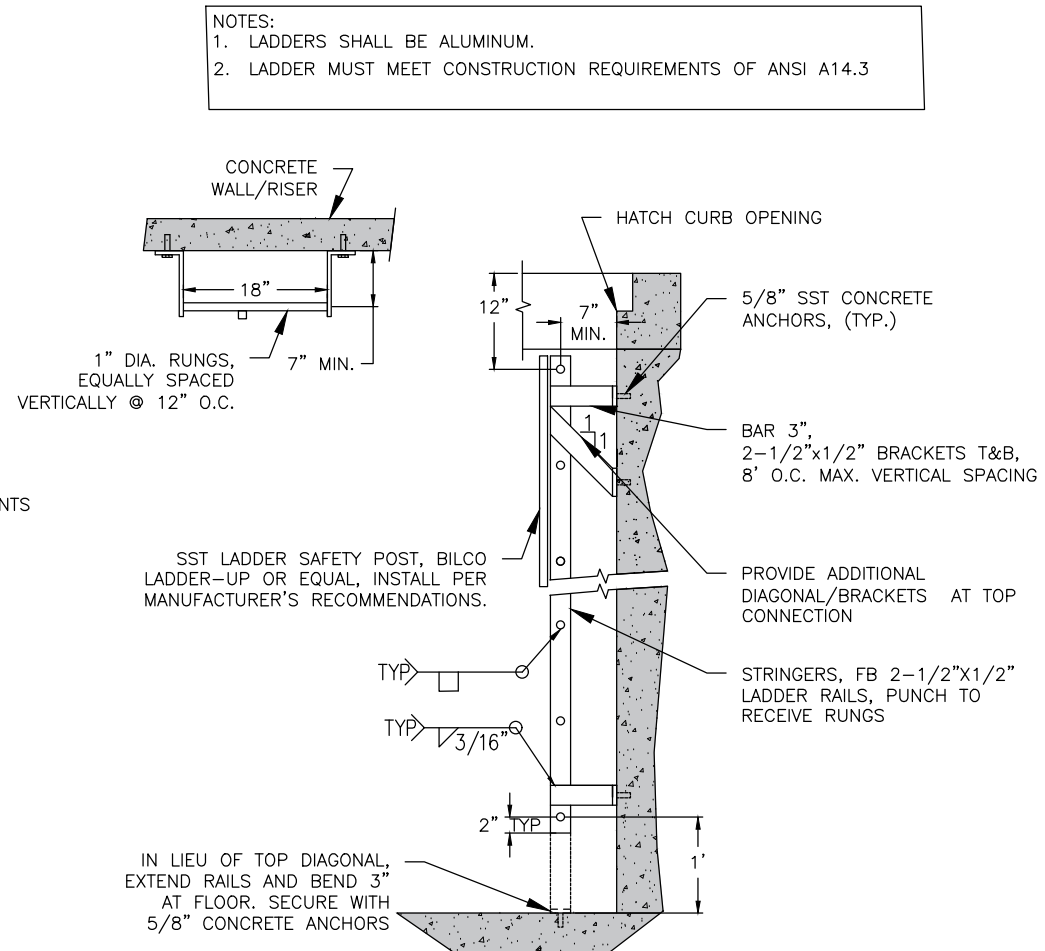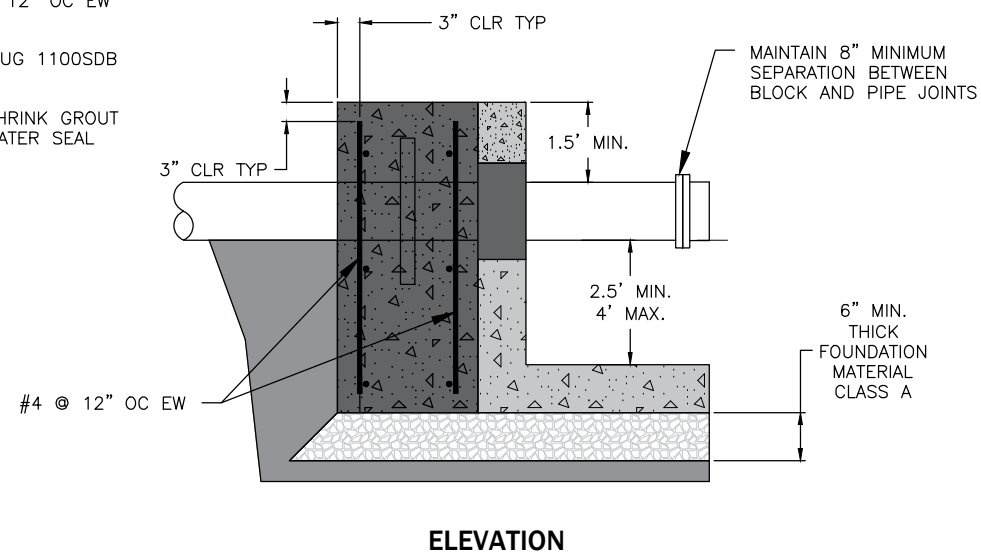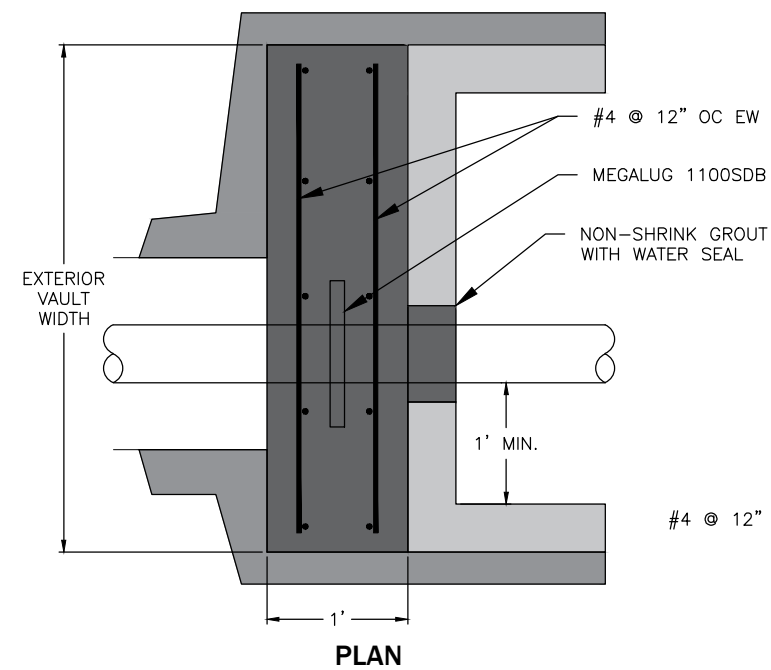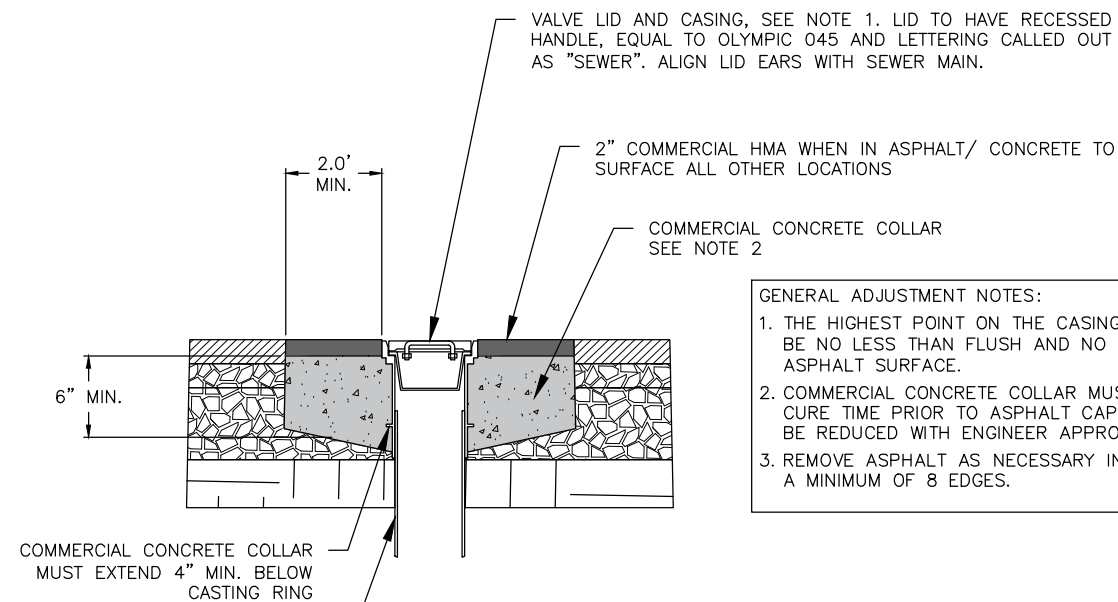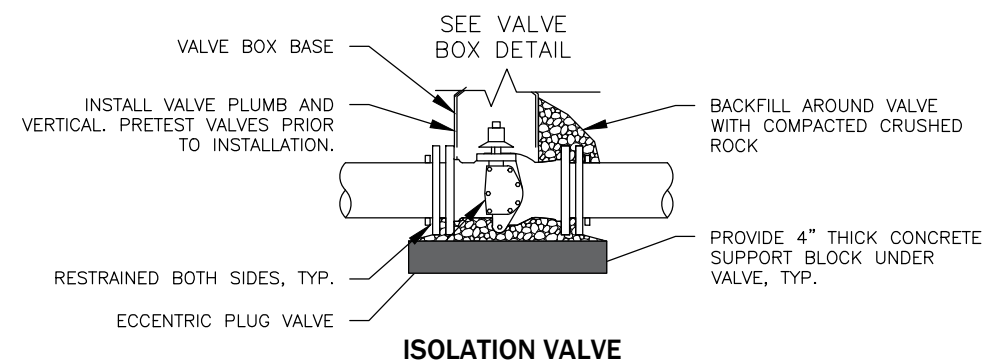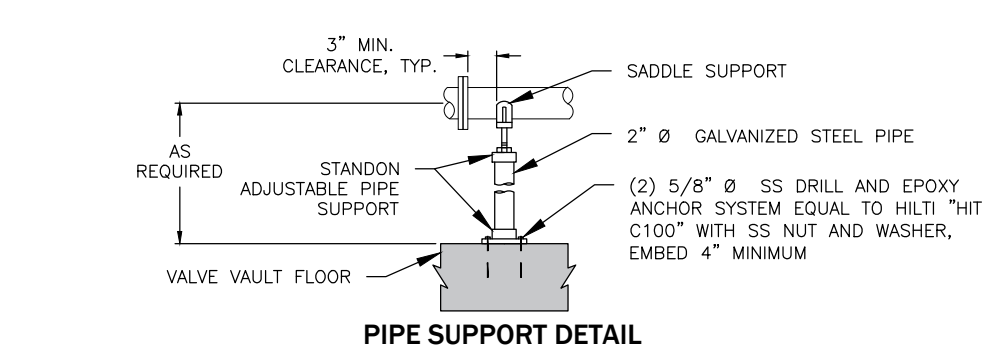

STANDARD DETAIL ELECTROMAGNETIC SEWAGE FLOW METER DETAILS

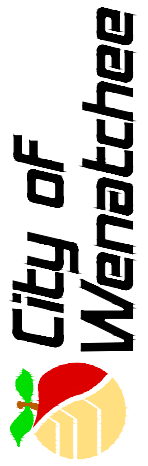


SCALE: AS SHOWN	DATE DRAWN	REVISIONS	
		DATE	INITIAL
NA	CHECKED	12/21/2020	CAW
DESIGNED		01/01/2022	AJS
APPROVED BY	DATE APPROVED		
STANDARD SPECIFICATIONS			


DETAIL NO.
S-320B

FLUME SIZING				
GPM	PARSHALL FLUME SIZE	VAULT SIZE	HATCH (MIN)	LEAF
3-73	2" - NOT TO BE USED WITH DOMESTIC SEWAGE	H2 PRE-CAST #577 OR EQUAL	48"x60"	2
13-250	3"	H2 PRE-CAST #577 OR EQUAL	48"x60"	2
>250	CONSULT WITH CITY OF WENATCHEE ENGINEERING STAFF	-		


METER VAULT ACCESS HATCH	
CLEAR OPENING	SEE TABLE
NO. OF LEAVES	SEE TABLE
RATING	H-20
MOUNTING*	ANCHOR
SAFETY GRATING**	YES
SAFETY CHAIN***	YES
GASKET	ODOR TIGHT
DRAIN	NO
SPRING ASSIST	YES
ACCESS HATCH NOTES: * ACCESS HATCH OVER METER VAULT SHALL BE MOUNTED USING STAINLESS STEEL BOLTS AS SHOWN ON THIS PLAN. **ACCESS HATCH SHALL HAVE REMOVABLE SAFETY GRATING COVER BELOW ACCESS HATCH LID. *** SAFETY CHAINS SHALL BE PROVIDED ON ACCESS HATCHES AS DETAILED FOR EACH HATCH ON THIS SHEET. ****ACCESS HATCH TO HAVE HASP FOR PADLOCK	

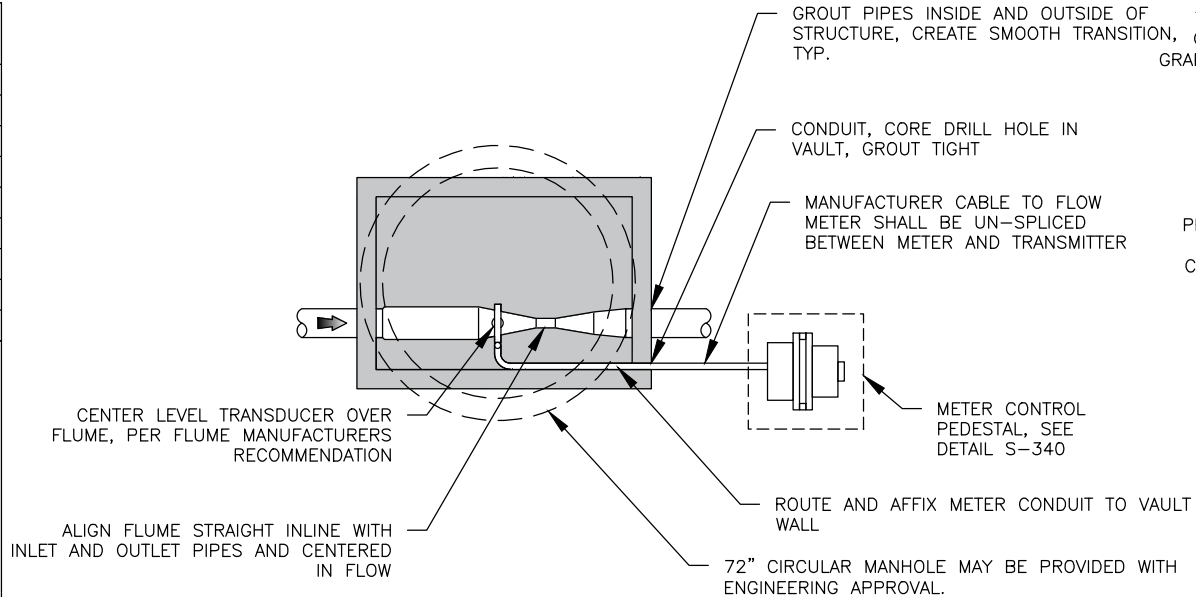

PARSHALL FLUME METER PLAN

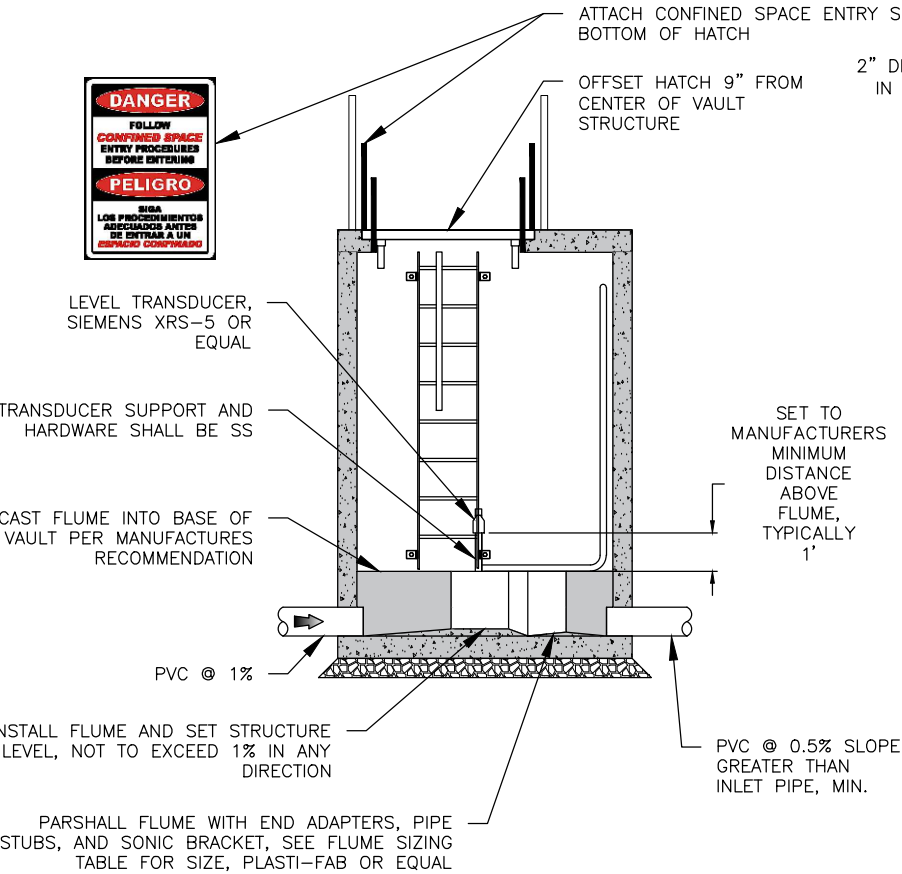


PARSHALL FLUME METER ELEVATION

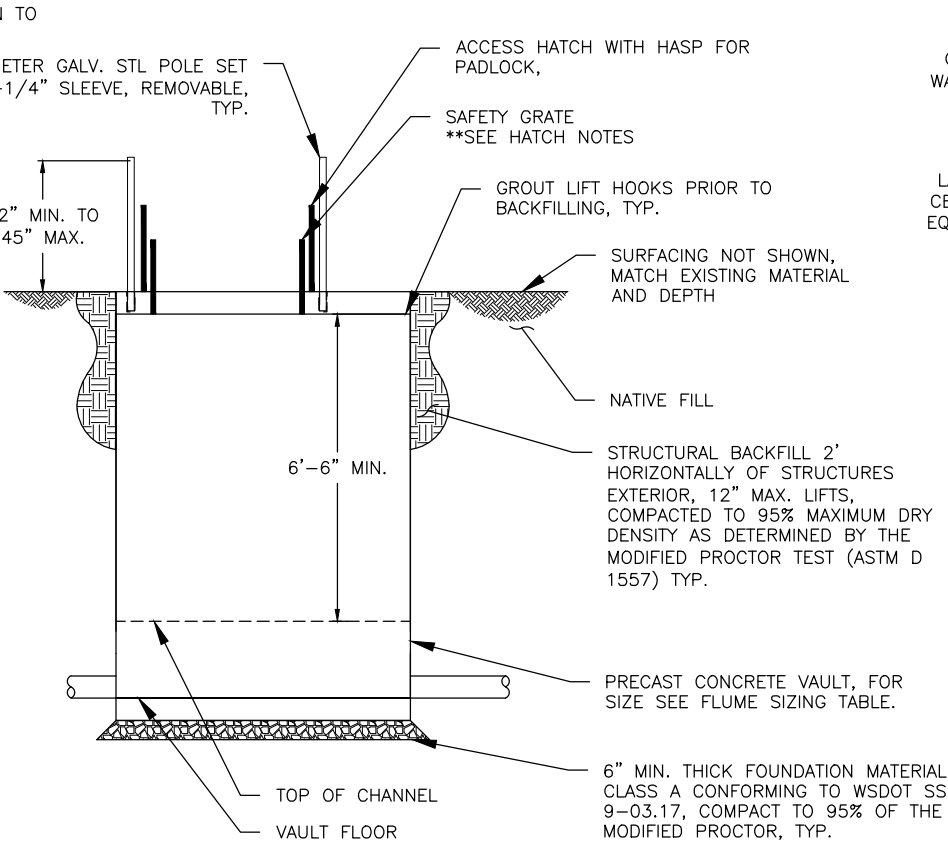


METER VAULT STRUCTURAL ELEVATION

PARSHALL FLUME METER NOTES	
1	CONTRACTOR SHALL TEST FLUME TO VERIFY CORRECT FLOW READING TO THE SATISFACTION OF CITY.

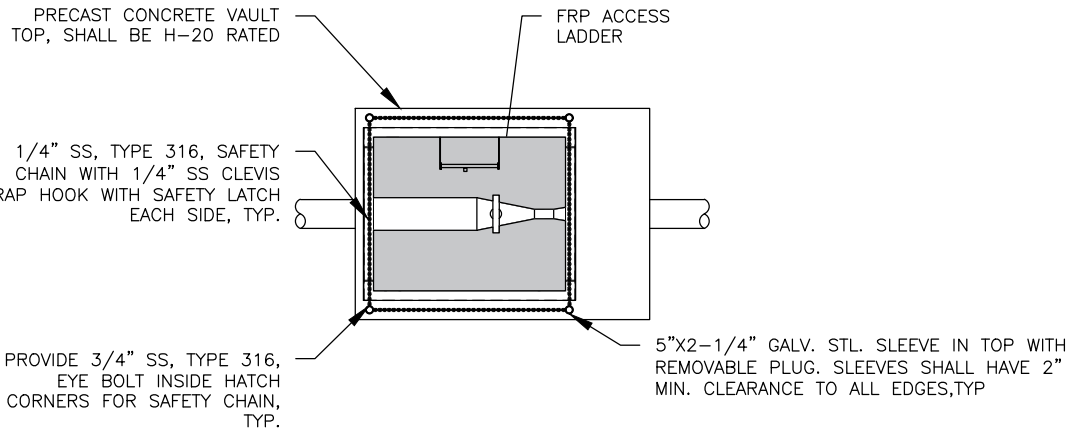

METER VAULT STRUCTURAL PLAN

LADDER NOTES:	
1.	LADDERS SHALL BE FIBER REINFORCED PLASTIC (FRP).
2.	LADDER MUST MEET CONSTRUCTION REQUIREMENTS OF ANSI A14.3
3.	LADDER BRACKET SHALL BE SERIES 625 VINYL-ESTER.
4.	ALL BOLT ASSEMBLIES AND GRATING HOLD DOWNS SHALL BE SERIES 316 STAINLESS STEEL.
5.	CONTRACTOR TO FIELD VERIFY ALL DIMENSION PRIOR TO FABRICATION.

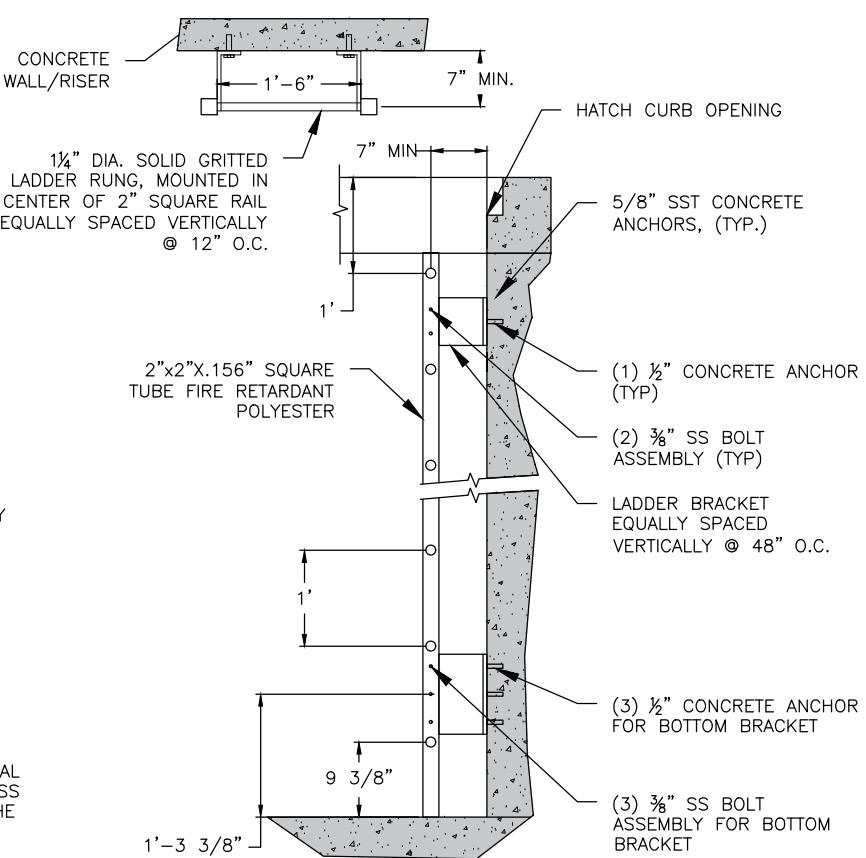


LADDER DETAIL FOR PARSHALL FLUME METER


STANDARD DETAIL
PARSHALL FLUME




SCALE:	AS SHOWN		DESIGNED	DRAWN	APPROVED BY	STANDARD SPECIFICATIONS
	NA	NA				
DATE DRAWN		DATE	INITIAL	DATE	INITIAL	
		12/21/2020	CAW	01/01/2022	AJS	
CHECKED				DATE APPROVED		

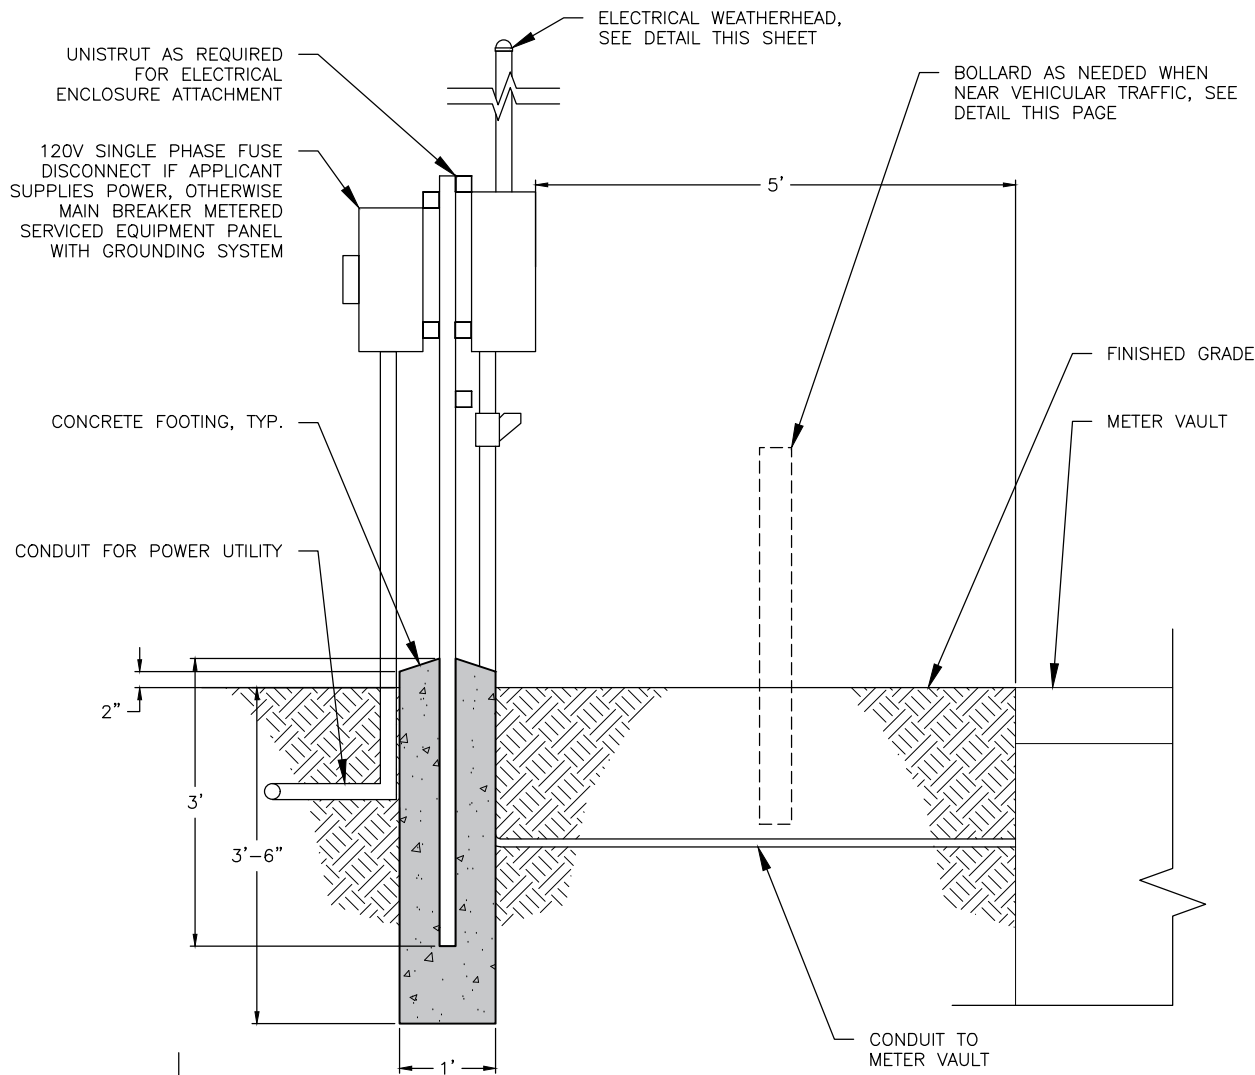


CONTROL PEDESTAL SIDE ELEVATION

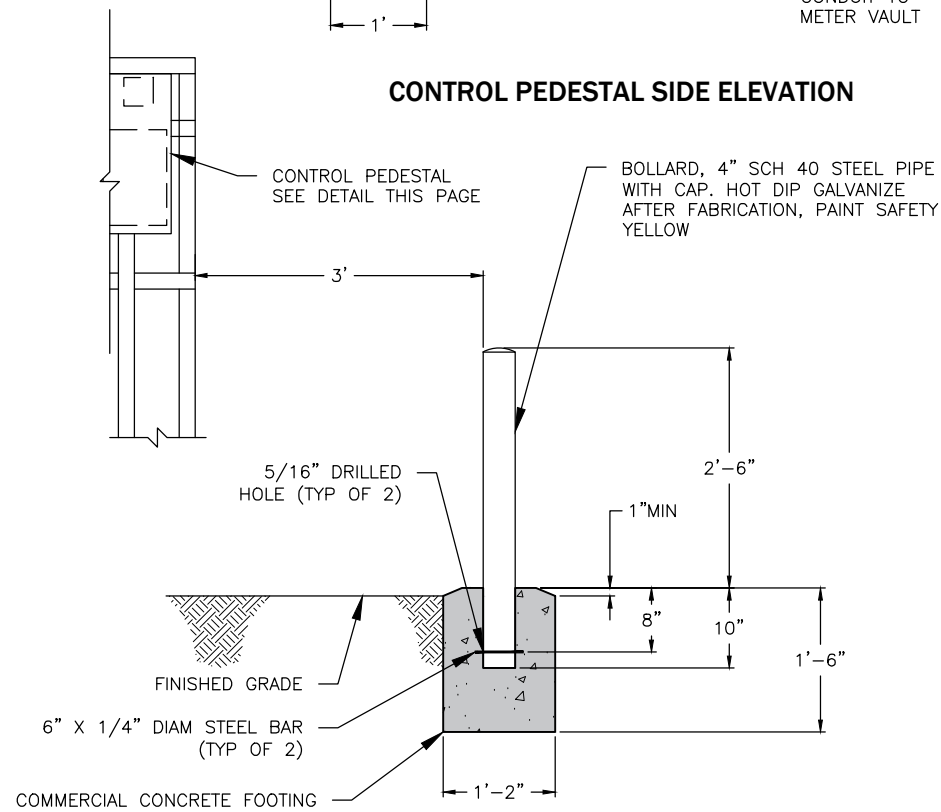

CONTROL PANEL BOLLARD

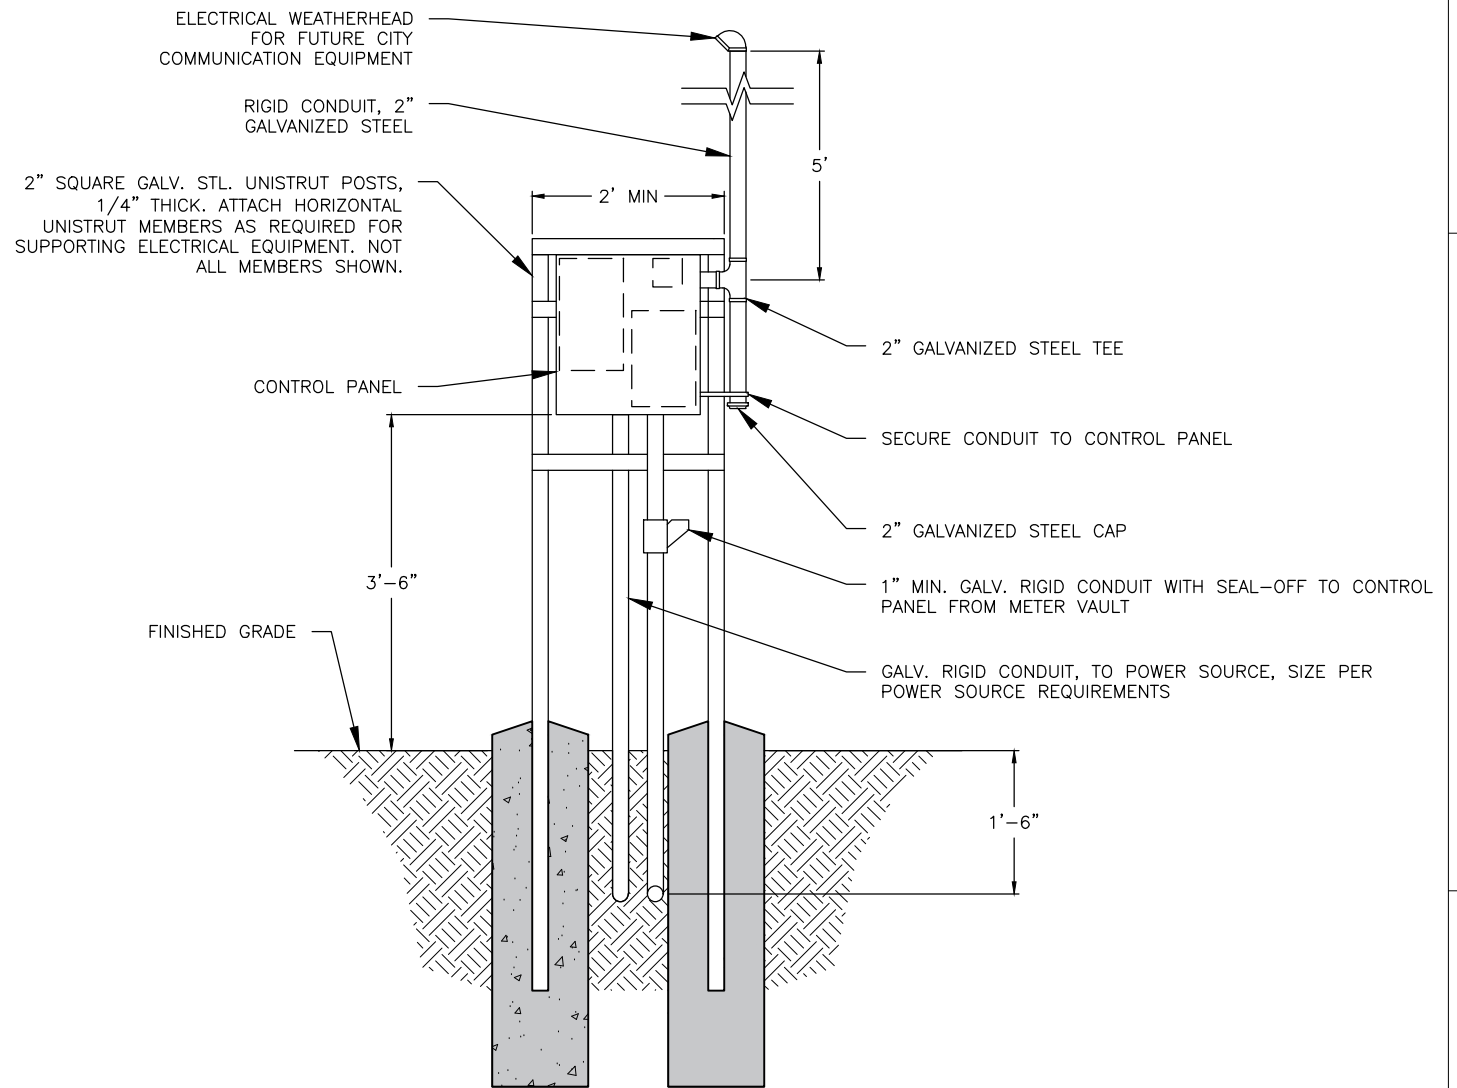

CONTROL PEDESTAL FRONT ELEVATION

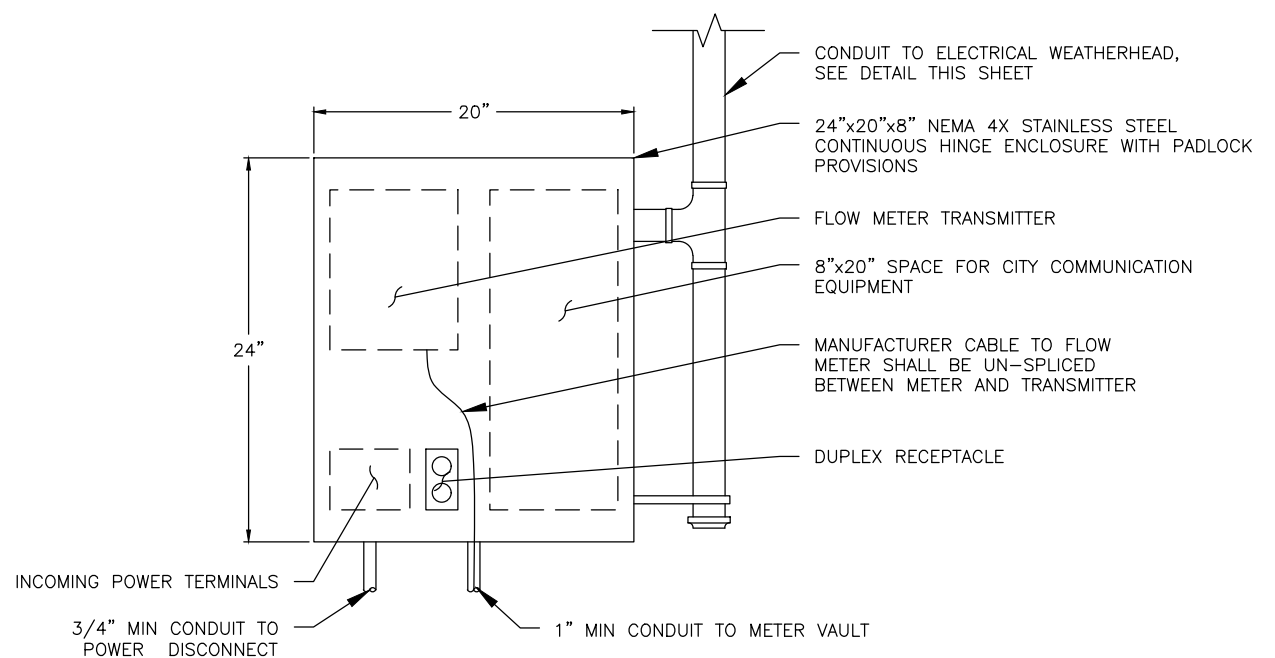

CONTROL PANEL LAYOUT

STANDARD DETAIL
SEWER CONTROL PEDESTAL



SCALE: AS SHOWN	DATE DRAWN	DATE	REVISIONS			
			INITIAL	DATE	BY	DATE
DESIGNED	CHECKED	12/21/2020	CAW	01/01/2022	AJS	
APPROVED BY	DATE APPROVED					
STANDARD SPECIFICATIONS						

DETAIL NO.

S-340

PAGE

1 OF 1



NOTES:

1. DEPTH OF CHANNEL MUST BE SAME AS PIPE DIAMETER.
2. MINIMUM 0.1' DROP ACROSS CHANNEL;
MAXIMUM 1.0' DROP ACROSS CHANNEL.

**STANDARD DETAIL
SEWER MANHOLE MAIN
CHANNEL & SHELF**



SCALE: AS SHOWN		DATE DRAWN 12/04/2020	DATE 01/01/2022	INITIAL AJS	REVISIONS
DESIGNED	DRAWN CAW	CHECKED			
APPROVED BY		DATE APPROVED			
STANDARD SPECIFICATIONS					

DETAIL NO.
S-400

PAGE
1 OF 1



- ① 24" DIAMETER GALVANIZED COVER
- ② POWER CONDUIT
- ③ 1-1/4" PVC TRUE UNION VALVE (SS) HAYWARD OR EQUAL
- ④ 1-1/4" PVC, COPPER, OR APPROVED EQUAL UNION
- ⑤ 1-1/4" PVC, COPPER, OR APPROVED EQUAL NIPPLES
- ⑥ CHECK VALVE AND PUMP DISCONNECT HYDROMATIC, GOULD, OR APPROVED EQUAL.
- ⑦ 2 HP GRINDER PUMP - SEE NOTES
- ⑧ 1-1/4" GALVANIZED PIPING, APPROXIMATELY 1.2' LONG
- ⑨ HOT DIPPED GALVANIZED STEEL RAIL GUIDE SYSTEM
- ⑩ HOT DIPPED GALVANIZED PUMP TECH SORT RAIL
- ⑪ 24" X 60" FIBERGLASS TANK

1. TOP OF TANK CAN BE SET FLUSH WITH GROUND, IF A CONCRETE PAD IS POURED AROUND THE LIFT STATION AND SLOPED AWAY FROM THE STATION. KEEP ROCKS AND DEBRIS OUT OF STATION.
2. ACCESS BOX:
 - TRAFFIC AREAS — EQUAL TO CARSON MODEL 1419-14B WITH 1419-2B COVER
 - TRAFFIC AREAS— H-20 RATED CONCRETE BOX EQUAL TO FOGTITE B9-1/2 METER BOX
 - LIDS SHALL BE MARKED ELECTRICAL OR SEWER RESPECTIVELY OR HAVE NO MARKINGS AT ALL.
3. CONTROL FLOATS NOT SHOWN FOR CLARITY.



**City of
Wenatchee**

SCALE: AS SHOWN		DRAWN	CHECKED	DATE	INITIAL	REV/ISSN
DESIGNED	CAW			01/07/2022	AJS	
APPROVED BY		DATE		APPROVED		
STANDARD SPECIFICATIONS						

DETAIL NO.

S-500

PAGE

1 OF 1